


# Standard Detail Index

## SECTION 1 SANITARY SEWER SYSTEM

<u>Detail #</u>	<u>Detail Description</u>
S-1.01.....	Standard Precast Concrete Manhole
S-1.02.....	Outside Drop Assembly Manhole
S-1.03.....	Standard Inside Drop Manhole
S-1.04.....	“Doghouse” Type Manhole
S-1.05.....	Flat Top Sealed and Vented Manhole
S-1.06.....	Sewage Air Release Manhole
S-1.07.....	Standard Manhole Ring and Cover
S-1.08.....	Standard Manhole Ring with Bolt Down Cover
S-1.09.....	Standard Manhole Ring and Cover for Watertight Manholes
S-1.10.....	Flat Top Sealed Ring and Cover
S-1.11.....	Manhole Ring and Cover Anchoring
S-1.12.....	Manhole Steps
S-1.13.....	Standard Sanitary Sewer Service
S-1.14.....	Sewer Lateral Connection to Manhole
S-1.15.....	Anti-Seep Collar
S-1.16.....	Ductile Iron (Rigid) Pipe Gravity Sewer Bedding
S-1.17.....	PVC (Flexible) Pipe Gravity Sewer Bedding
S-1.18.....	Typical Trench Gravity Sewer and Force Main
S-1.19.....	Pipe Installation in Steel Encasement
S-1.20.....	HPDE/Fusible PVC Transition
S-1.21.....	Low Pressure Air Testing for Gravity Sewer Mains
S-1.22.....	Typical Two Compartment Grease Interceptor Tank
S-1.23.....	Typical Pump Station Layout



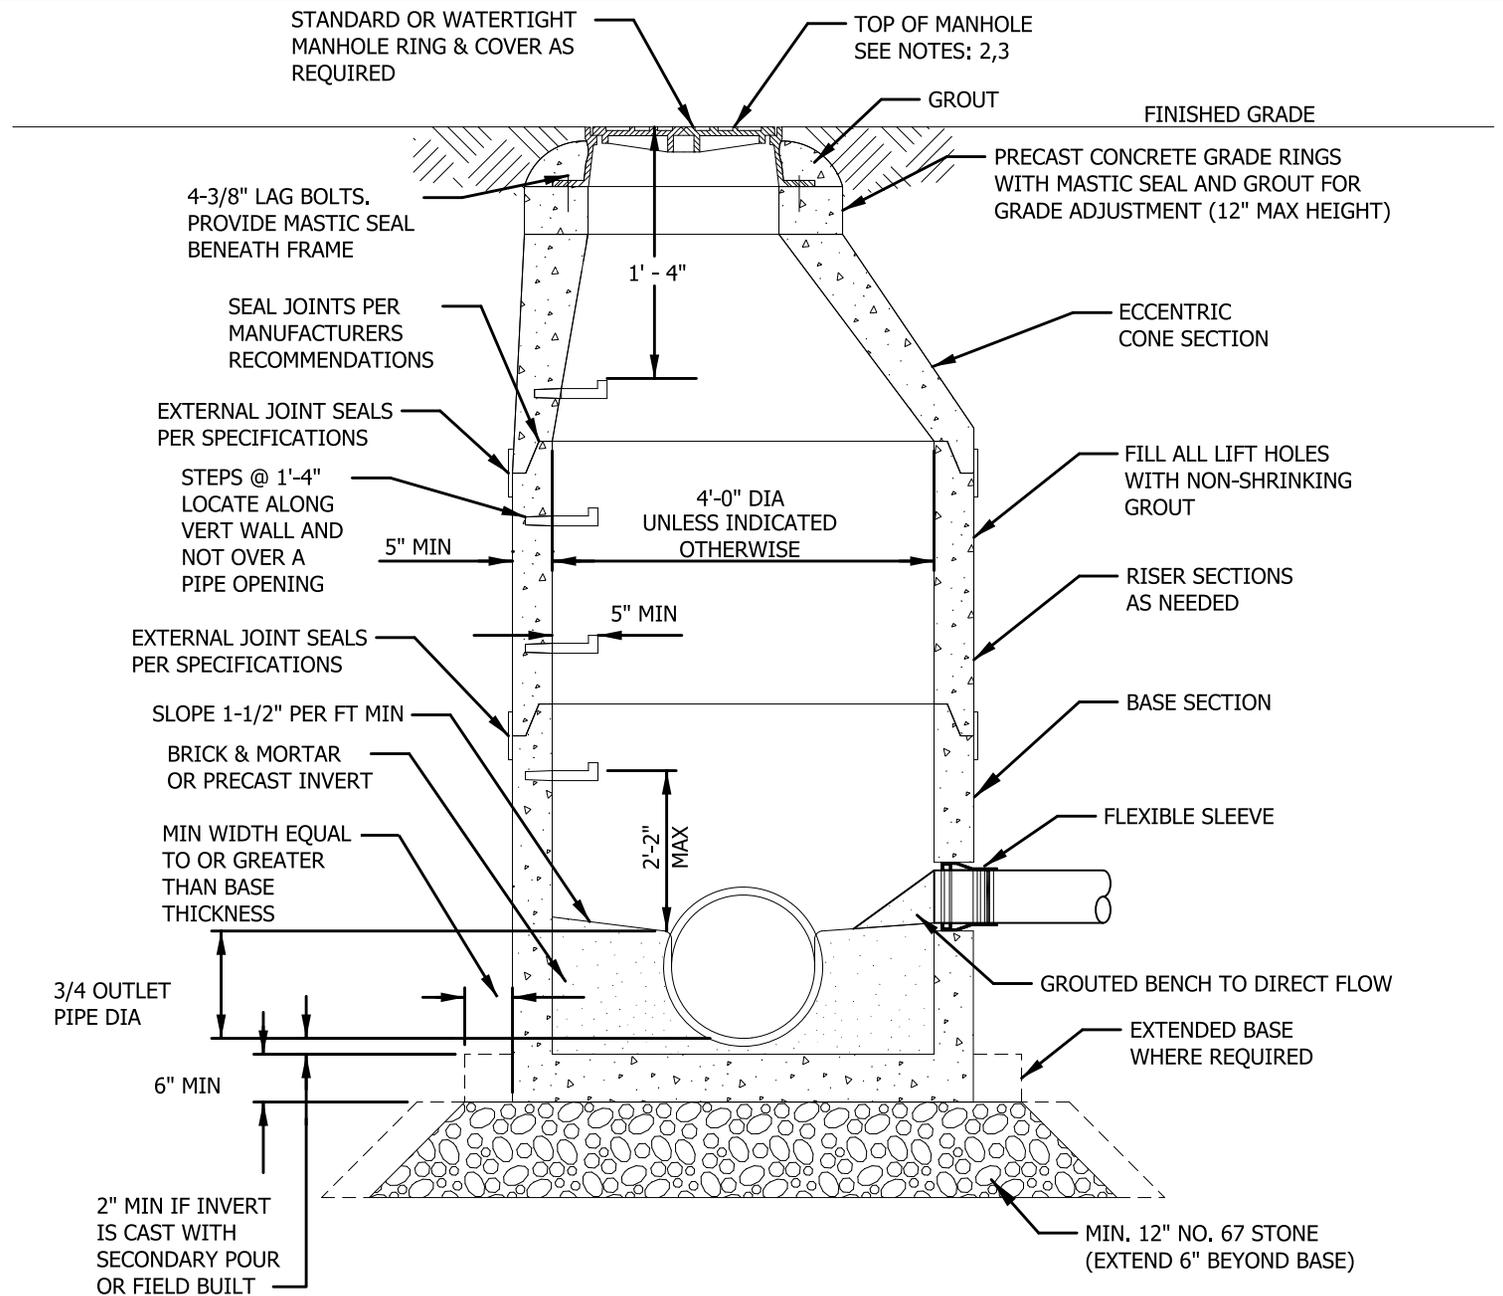

**NOTES:**

- 1) PRECAST MANHOLE SHALL CONFORM TO ASTM C478 WITH AASHTO M198 BUTYL SEALS BETWEEN JOINTS AND 6" ADHESIVE TAPE ON THE OUTSIDE OF JOINTS.
- 2) MANHOLE RING SHALL BE FLUSH WITH PAVED SURFACES AND LAWNS. SET 2 TO 3 FEET ABOVE GRADE IN UNIMPROVED AREAS.
- 3) MANHOLE RIMS SHALL BE SET 2 FEET ABOVE 100 YEAR FLOOD ELEVATION, OR USE WATERTIGHT LIDS.
- 4) USE 5' DIA. MANHOLE WHERE DEPTH IS GREATER THAN 15 FEET.
- 5) HOLES FOR CONNECTION OF PIPE TO MANHOLE SHALL BE PRECAST OR CORED. DIAMETER OF HOLE SHALL NOT EXCEED OUTSIDE DIAMETER OR PIPE BY MORE THAN 3 INCHES.
- 6) CONNECTION OF PIPE TO MANHOLE SHALL BE MADE WATERTIGHT USING RESILIENT CONNECTORS CONFORMING TO ASTM C 923 OR NEOPRENE BOOTS EMBEDDED IN PRECAST BASE WITH STAINLESS STEEL COMPRESSED BANDS.


# STANDARD PRECAST CONCRETE MANHOLE

## STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.01



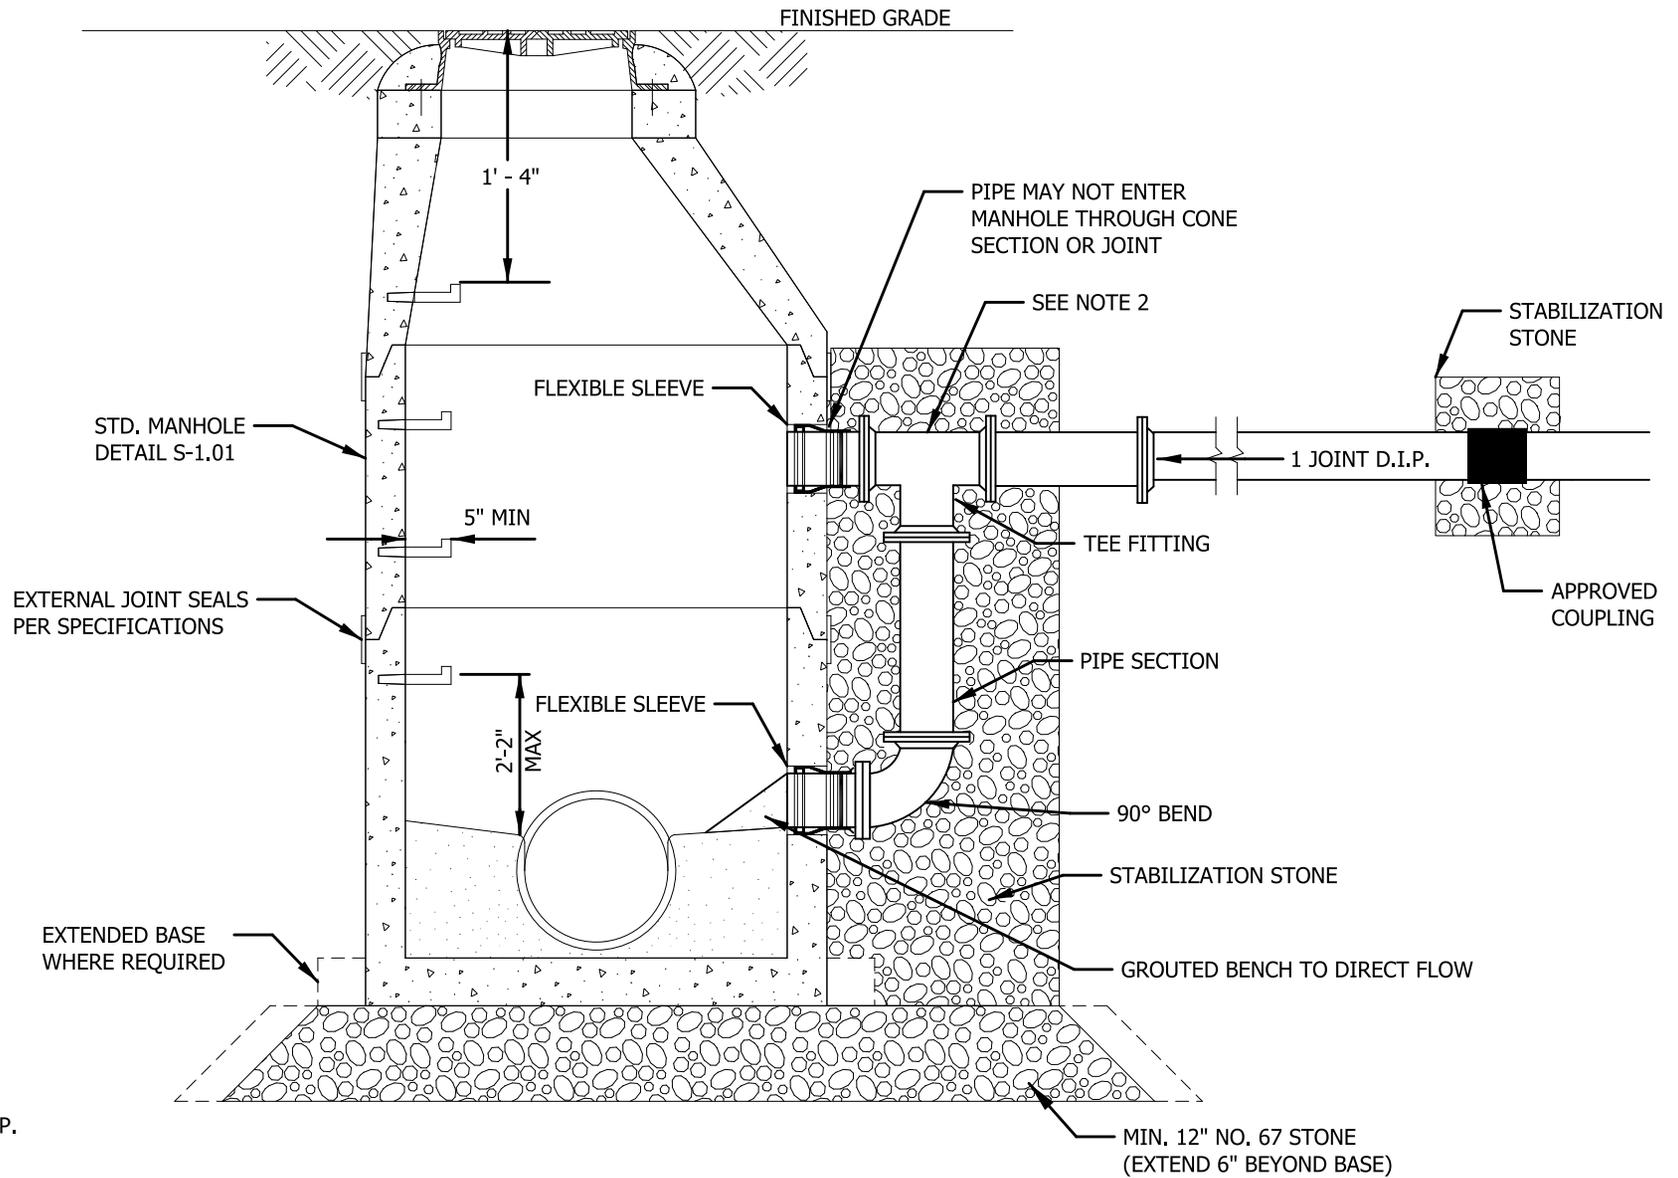

NOTES:

- 1) TO BE CONSTRUCTED FOR DROPS OVER 30".
- 2) USE TEE FITTING WHERE PIPE SIZE AND REQUIRED DROP HEIGHT PROHIBIT USE OF WYE AND 45° BEND.
- 3) DROP ASSEMBLY TO BE D.I.P.

## OUTSIDE DROP ASSEMBLY MANHOLE

### STANDARD DETAIL

DATE: REVISIONS


DATE: 03/07/2017

SHEET 1 OF 1


STD. No. S-1.02



Clinton  
NORTH CAROLINA

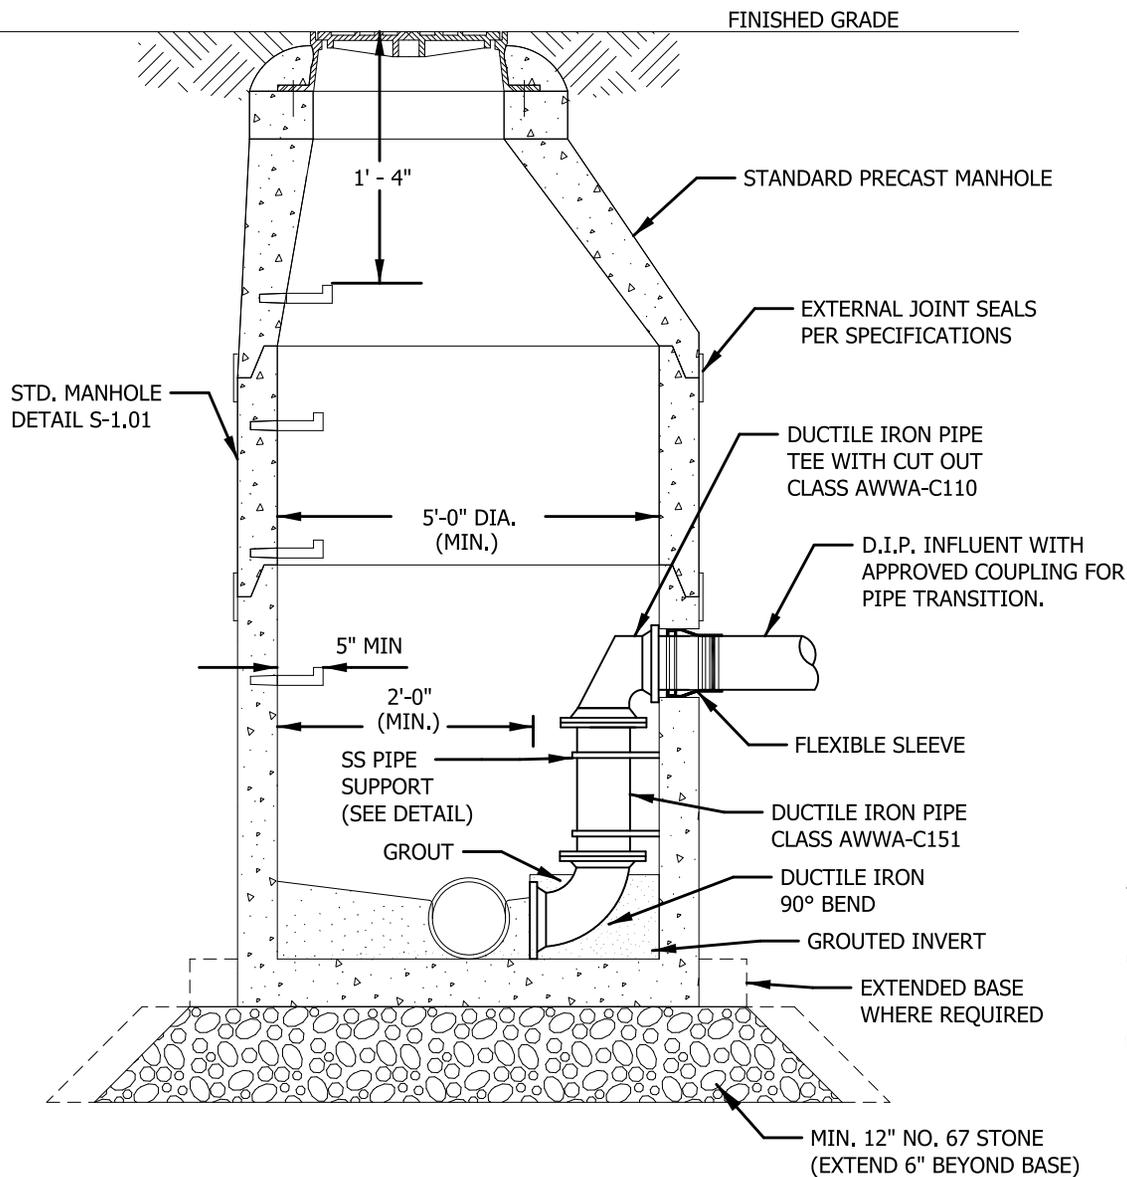

2" X 1/4" STAINLESS STEEL STRAP AND DOUBLE NUTS. TIGHTEN SNUG AROUND PIPE. DO NOT COMPRESS PIPE OR TEFLON SHEETING.

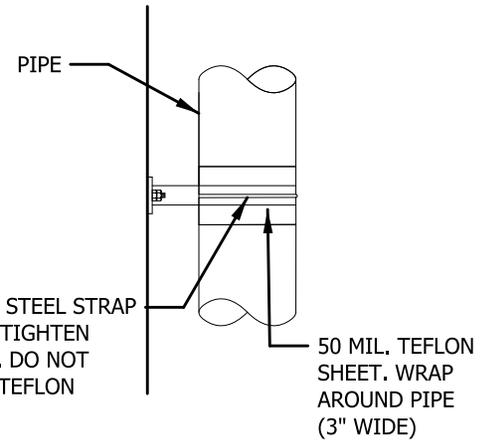

STAINLESS STEEL PIPE SUPPORT STRAP

**NOTES:**

- 1) PIPE SIZE FOR DROP TO EQUAL INFLOW SEWER PIPE SIZE.
- 2) MECH. JOINT OR PUSH-ON FITTINGS, ALL BELL, TO BE USED.
- 3) SAW-CUT OR DRILL ALL HOLES FOR PIPE AND BOLTS.
- 4) DROP-MANHOLE MANDATORY WHEN DIFFERENTIAL BETWEEN INVERTS IS GREATER THAN 30".
- 5) INSTALL STAINLESS STEEL STRAPS WITHIN 12" OF EACH PIPE JOINT AND AT 18 INCH MAX SPACING (MIN 2 REQD).
- 6) INSIDE DROP TO BE USED WHEN REQUIRED WITHIN PAVED AREAS OR OTHER AREAS WITH PRIOR WRITTEN APPROVAL FROM CITY.



## STANDARD INSIDE DROP MANHOLE

### STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.03



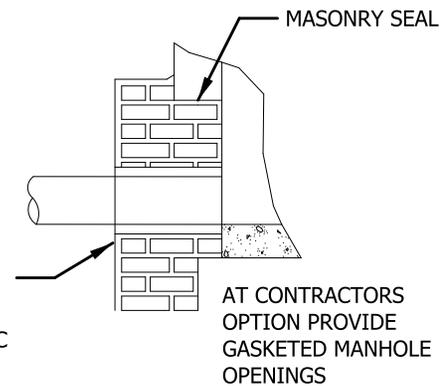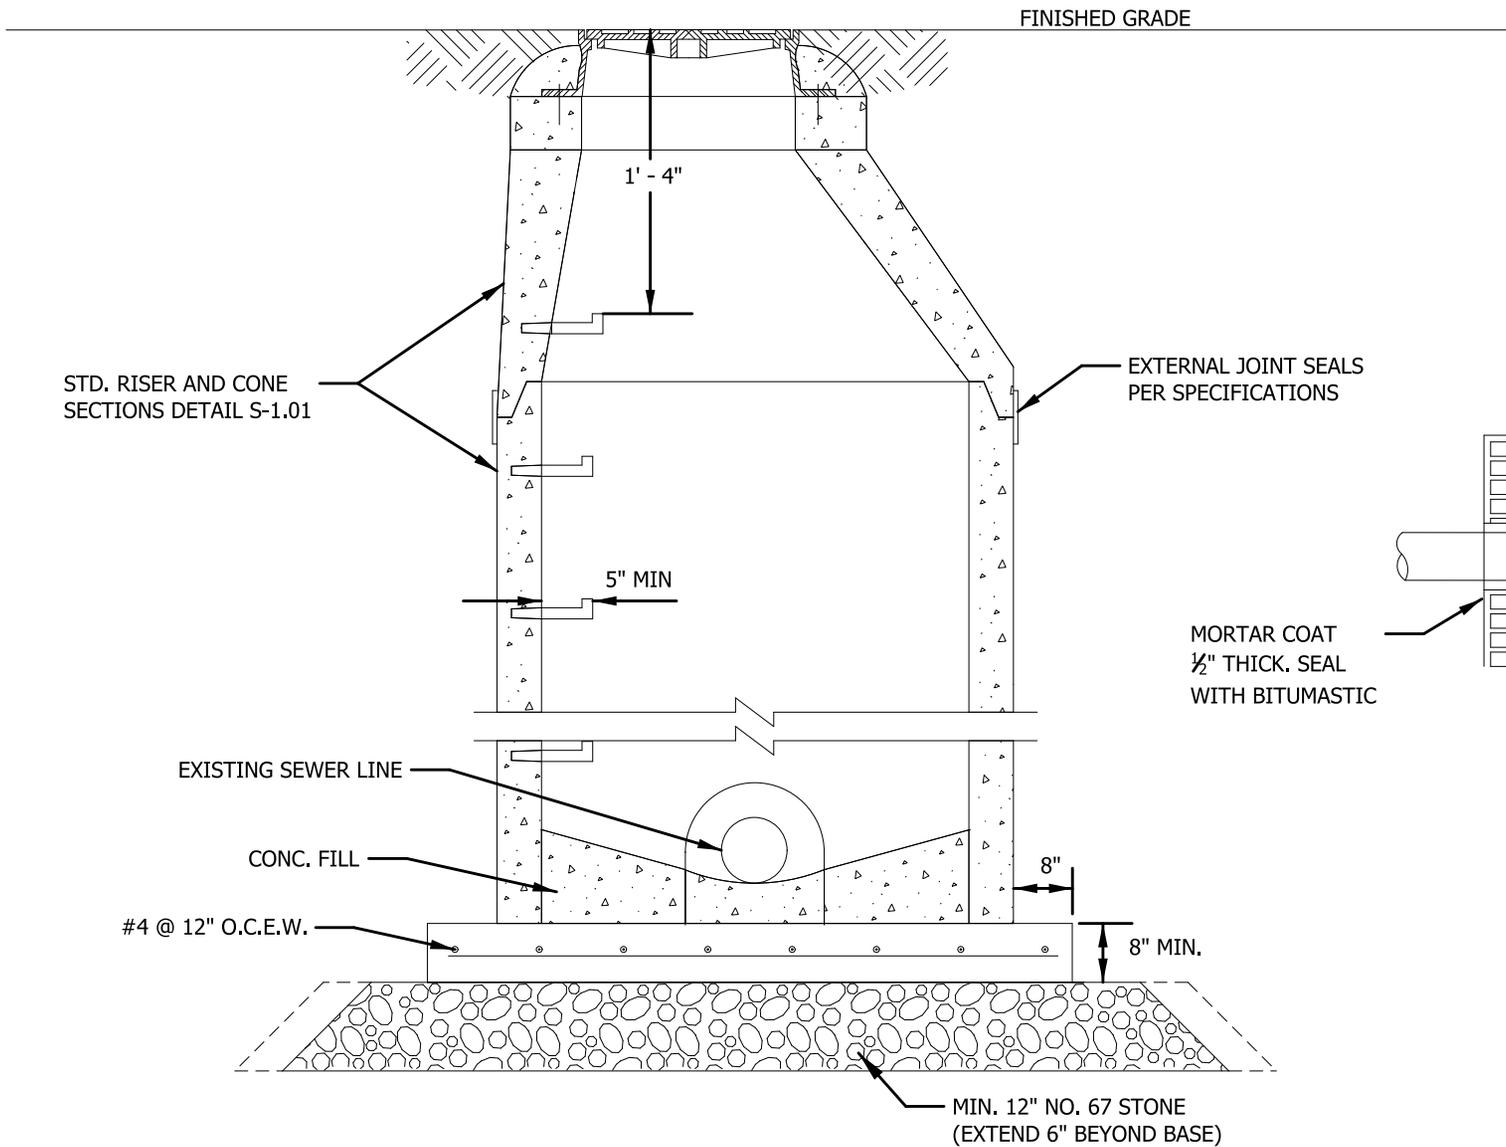

NOTE:  
 USE OF "DOGHOUSE" TYPE MANHOLE  
 MUST BE APPROVED BY THE CITY


# "DOGHOUSE" TYPE MANHOLE

## STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.04



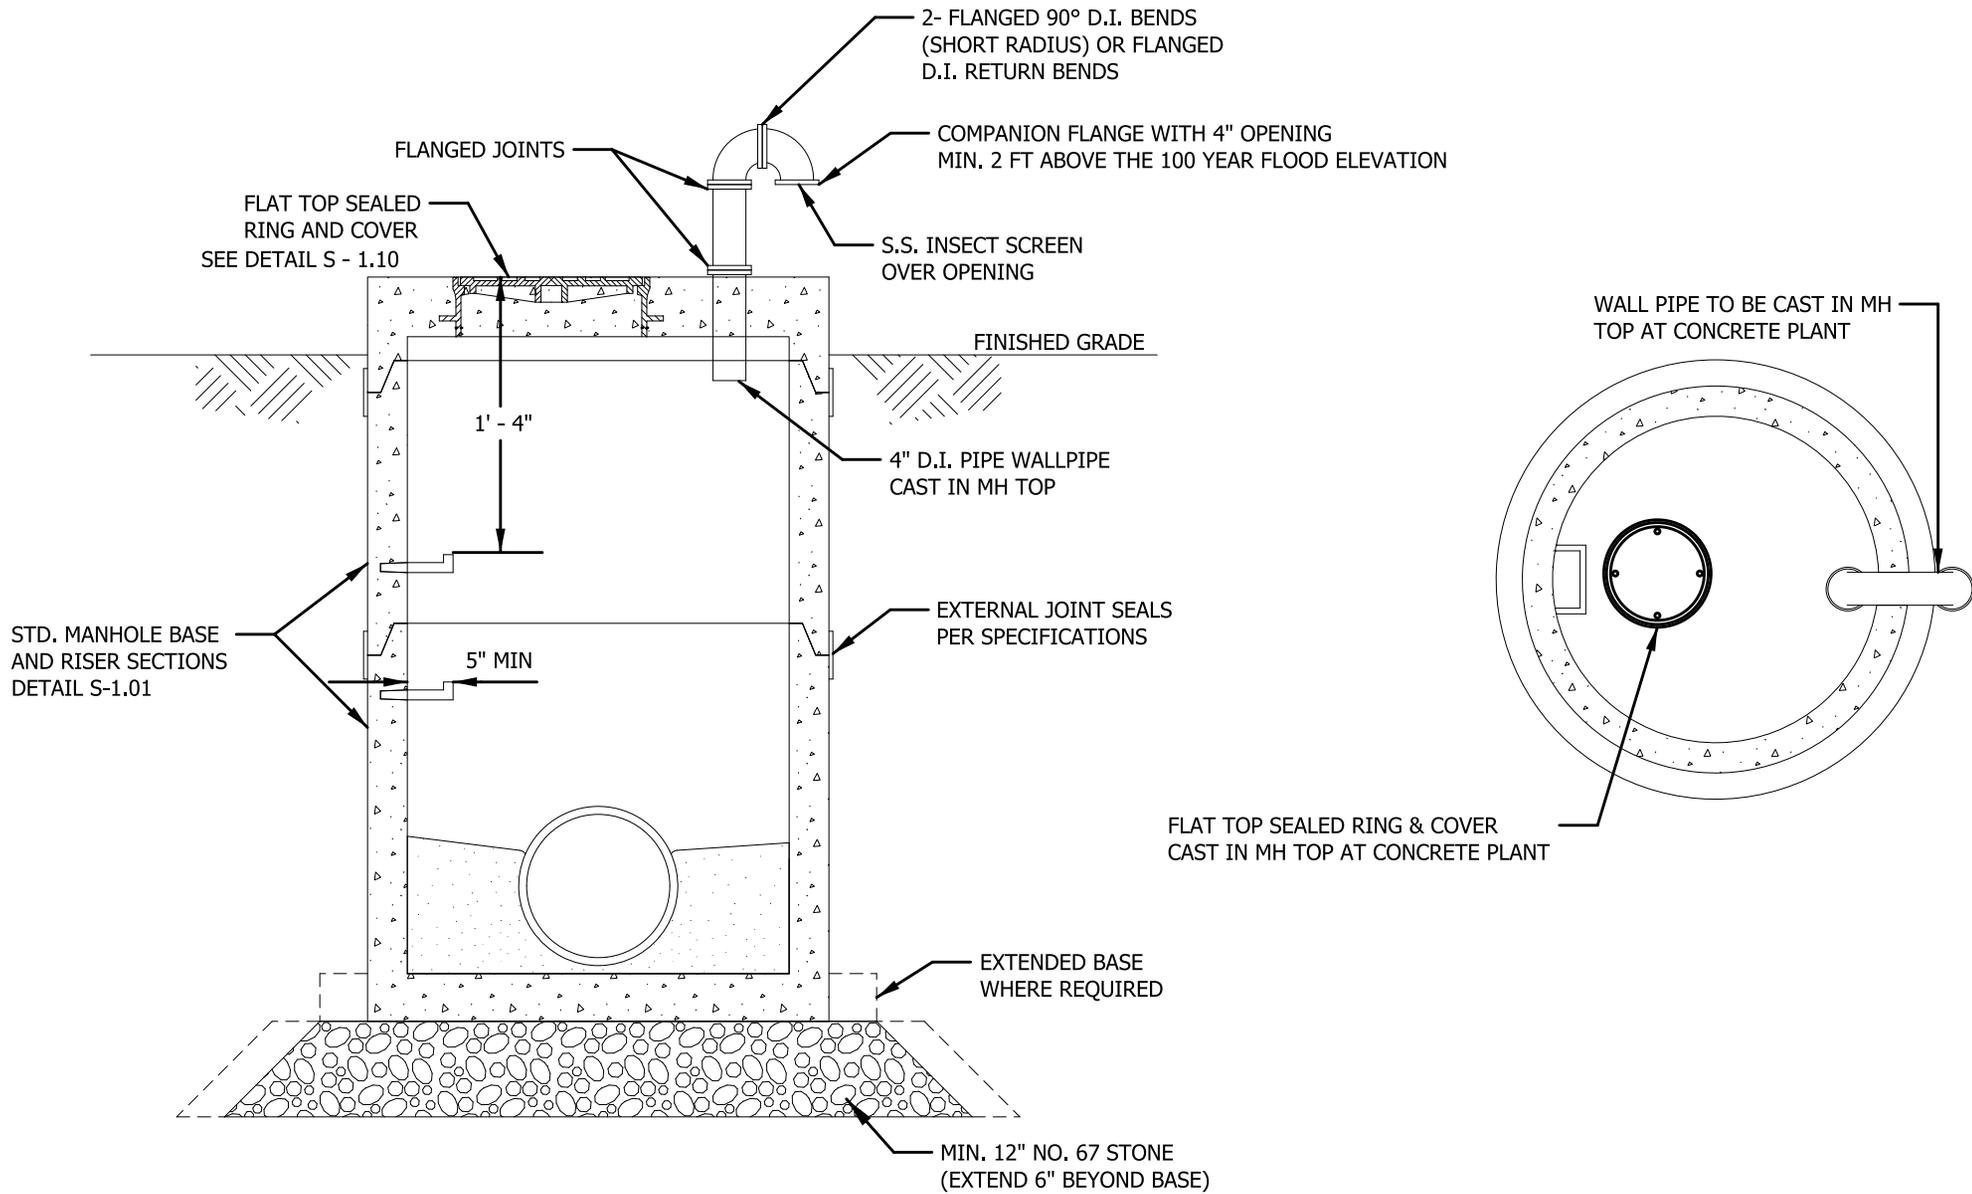

## FLAT TOP SEALED AND VENTED MANHOLE

DATE:	REVISIONS


### STANDARD DETAIL

DATE: 03/07/2017

SHEET 1 OF 1

STD. No. S-1.05



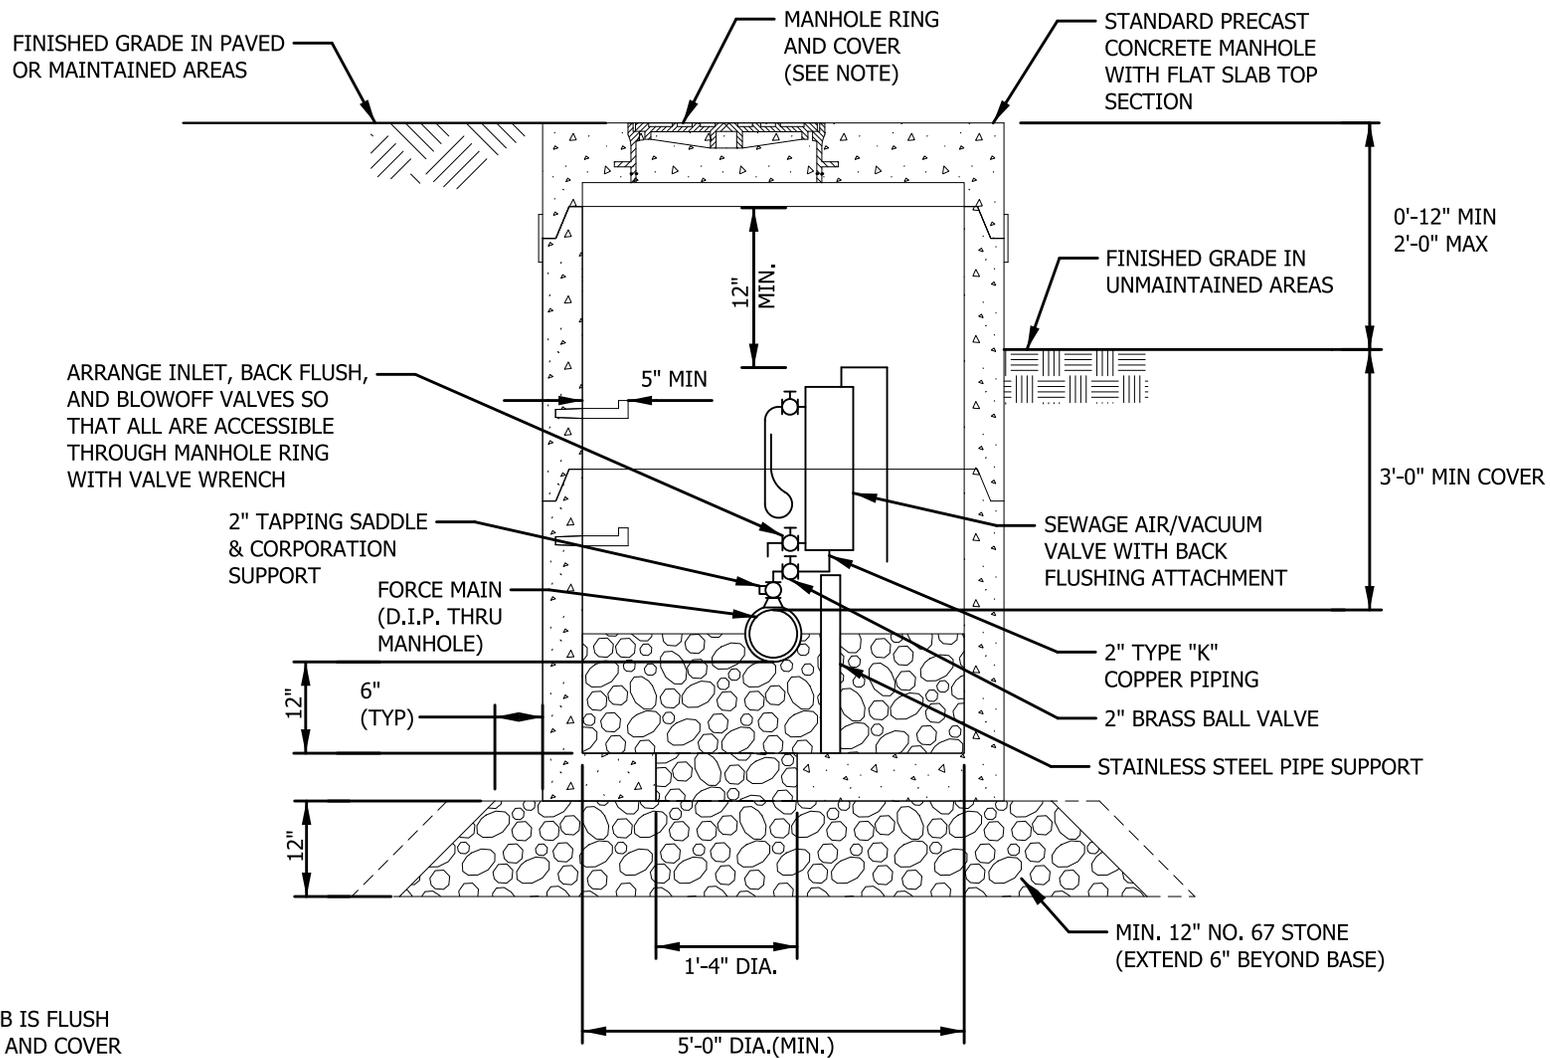

NOTE:  
 WHERE TOP OF SLAB IS FLUSH  
 WITH GRADE, RING AND COVER  
 CAST IN SLAB AS PER DETAIL S-1.10

## SEWAGE AIR RELEASE MANHOLE

### STANDARD DETAIL

DATE: 03/07/2017


SHEET 1 OF 1

STD. No. S-1.06



Clinton  
NORTH CAROLINA


DATE:	REVISIONS

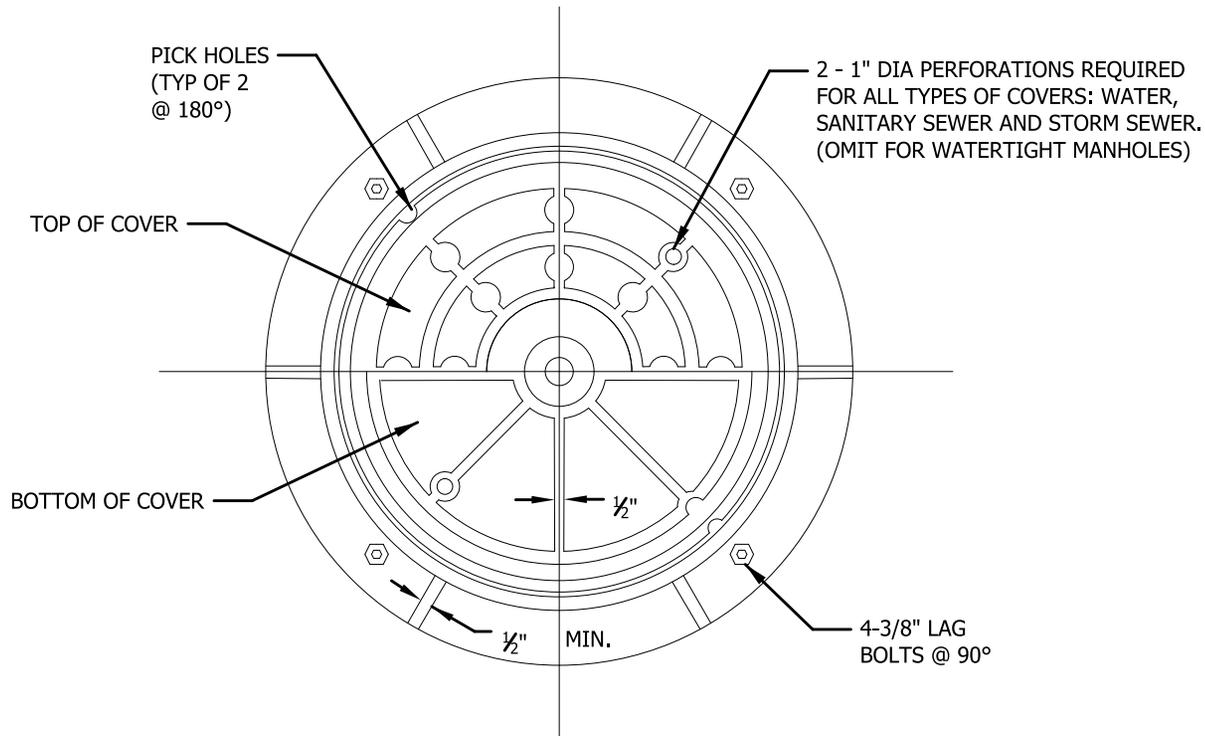

COVER LETTERING DETAIL

**NOTES:**

- 1) RING AND COVER SHALL HAVE TOTAL COMBINED WEIGHT OF 310 LB MIN. AND BE SUITABLE FOR H-20 LOADING.
- 2) ALL BOLTS ARE TO BE TYPE 316 STAINLESS STEEL.
- 3) USE COVER LETTERING AS APPROPRIATE FOR APPLICATION.

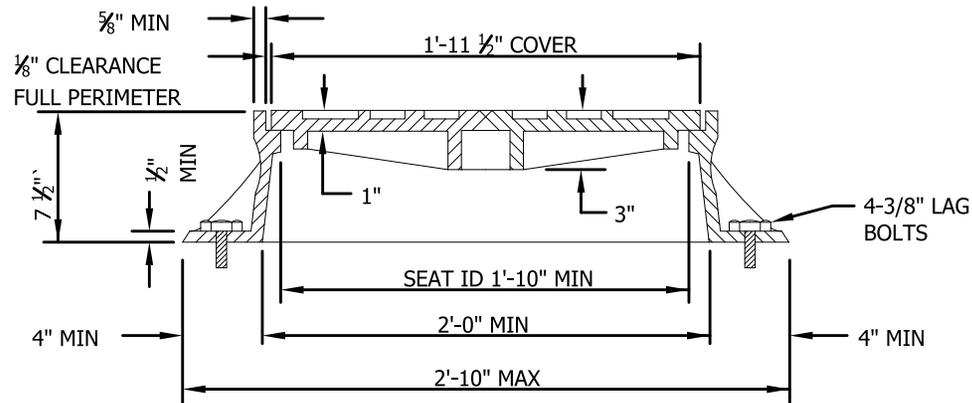


## STANDARD MANHOLE RING AND COVER

DATE:	REVISIONS


# STANDARD DETAIL

DATE: 03/07/2017  
 SHEET 1 OF 1  
 STD. No. S-1.07



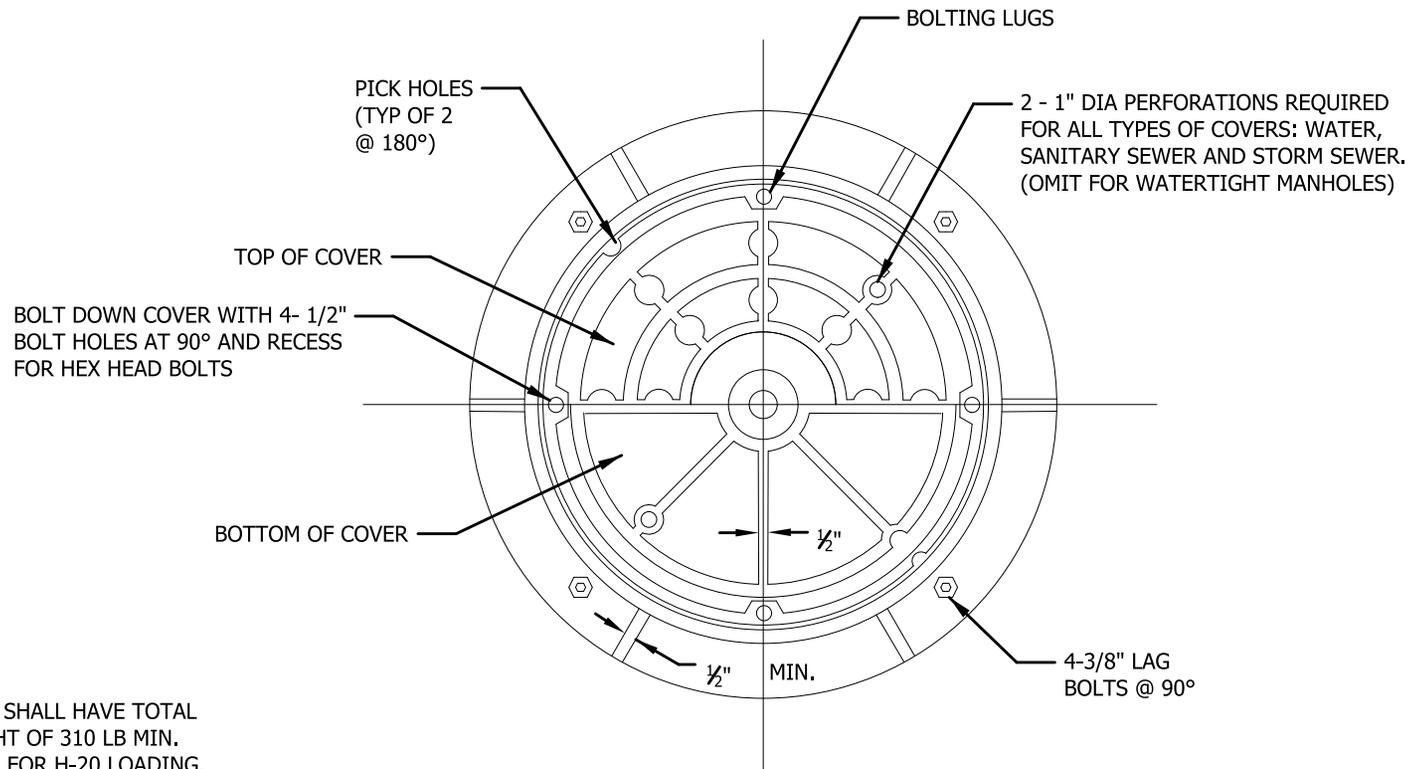

- NOTES:
- 1) RING AND COVER SHALL HAVE TOTAL COMBINED WEIGHT OF 310 LB MIN. AND BE SUITABLE FOR H-20 LOADING.
  - 2) ALL BOLTS ARE TO BE TYPE 316 STAINLESS STEEL.
  - 3) USE COVER LETTERING AS APPROPRIATE FOR APPLICATION.

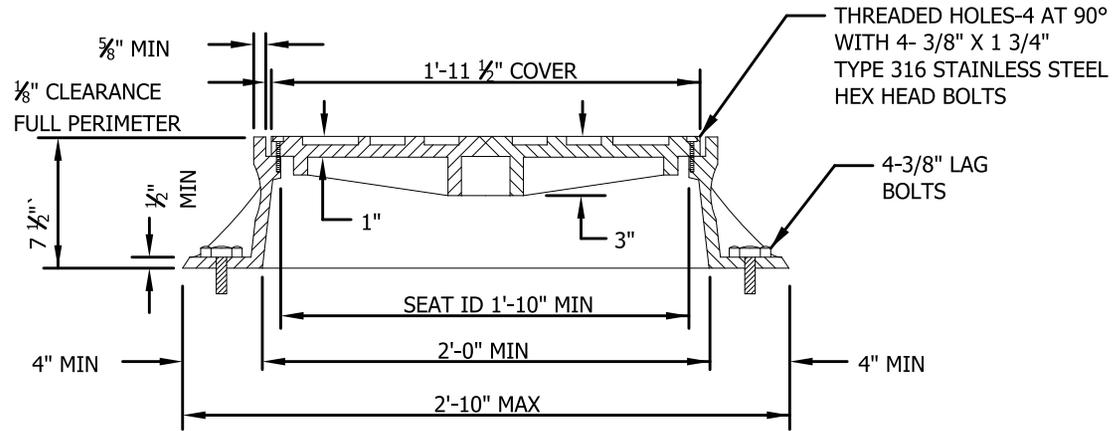


**STANDARD MANHOLE RING WITH BOLT DOWN COVER**

**STANDARD DETAIL**

DATE:	REVISIONS


DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.08



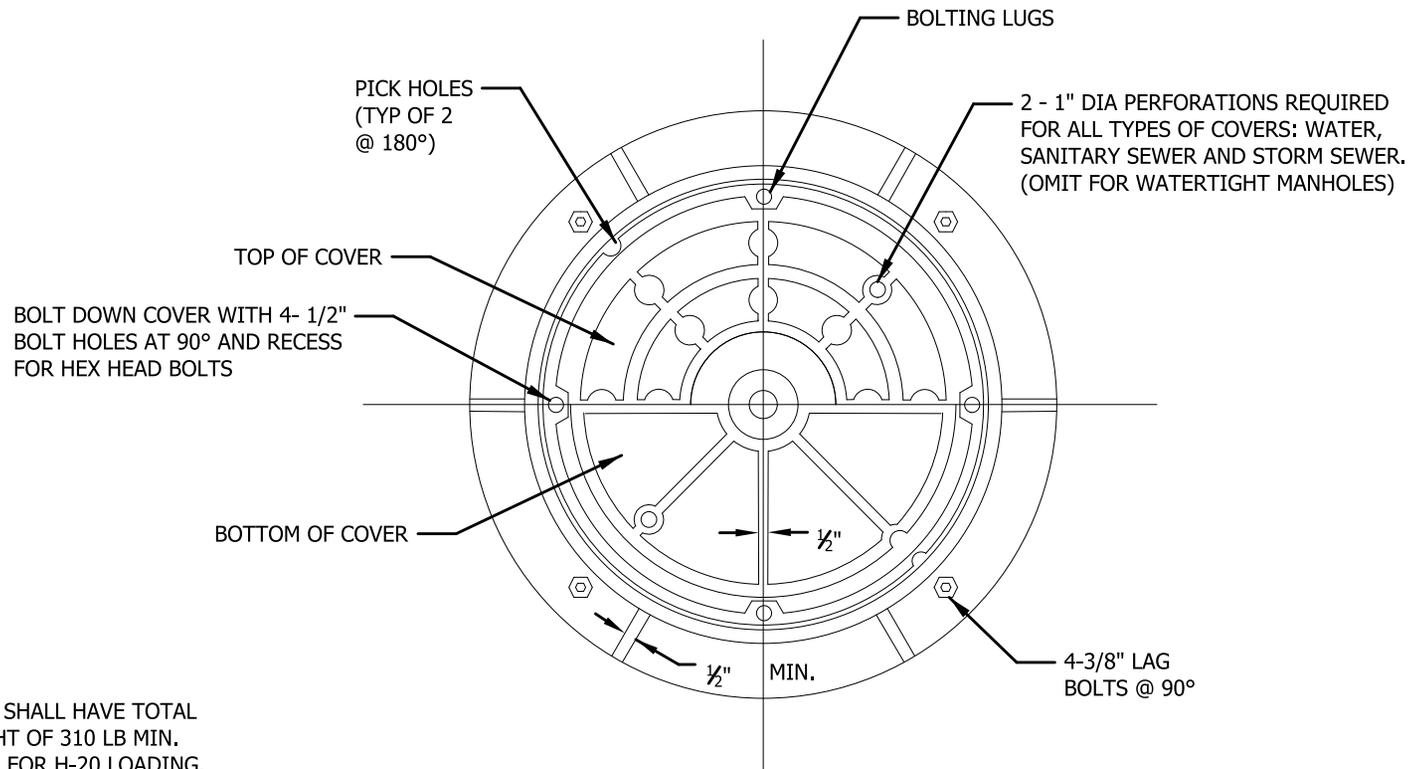

COVER LETTERING DETAIL

- NOTES:
- 1) RING AND COVER SHALL HAVE TOTAL COMBINED WEIGHT OF 310 LB MIN. AND BE SUITABLE FOR H-20 LOADING.
  - 2) ALL BOLTS ARE TO BE TYPE 316 STAINLESS STEEL.
  - 3) USE COVER LETTERING AS APPROPRIATE FOR APPLICATION.

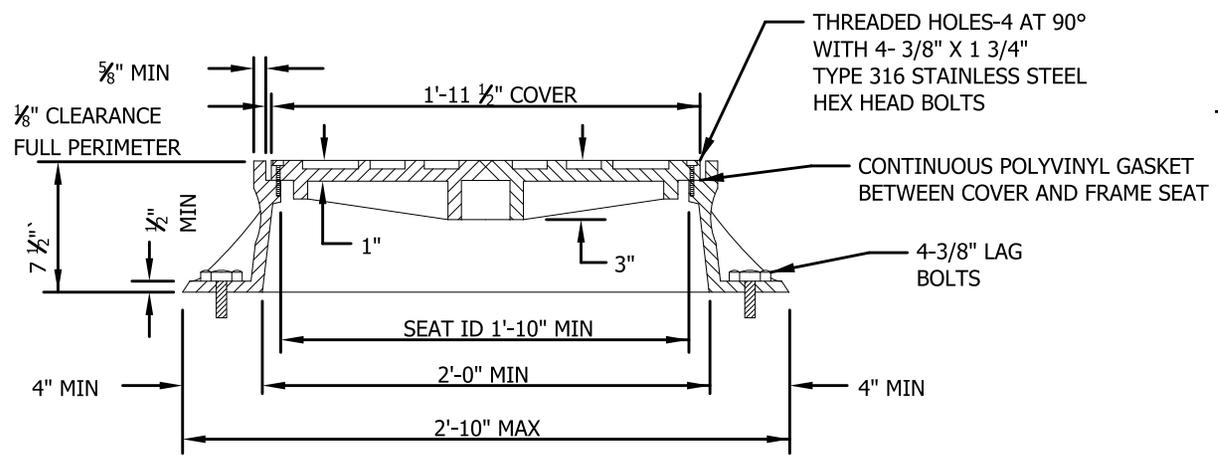


## STANDARD MANHOLE RING AND COVER FOR WATERTIGHT MANHOLES

DATE:	REVISIONS

# STANDARD DETAIL


DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.09



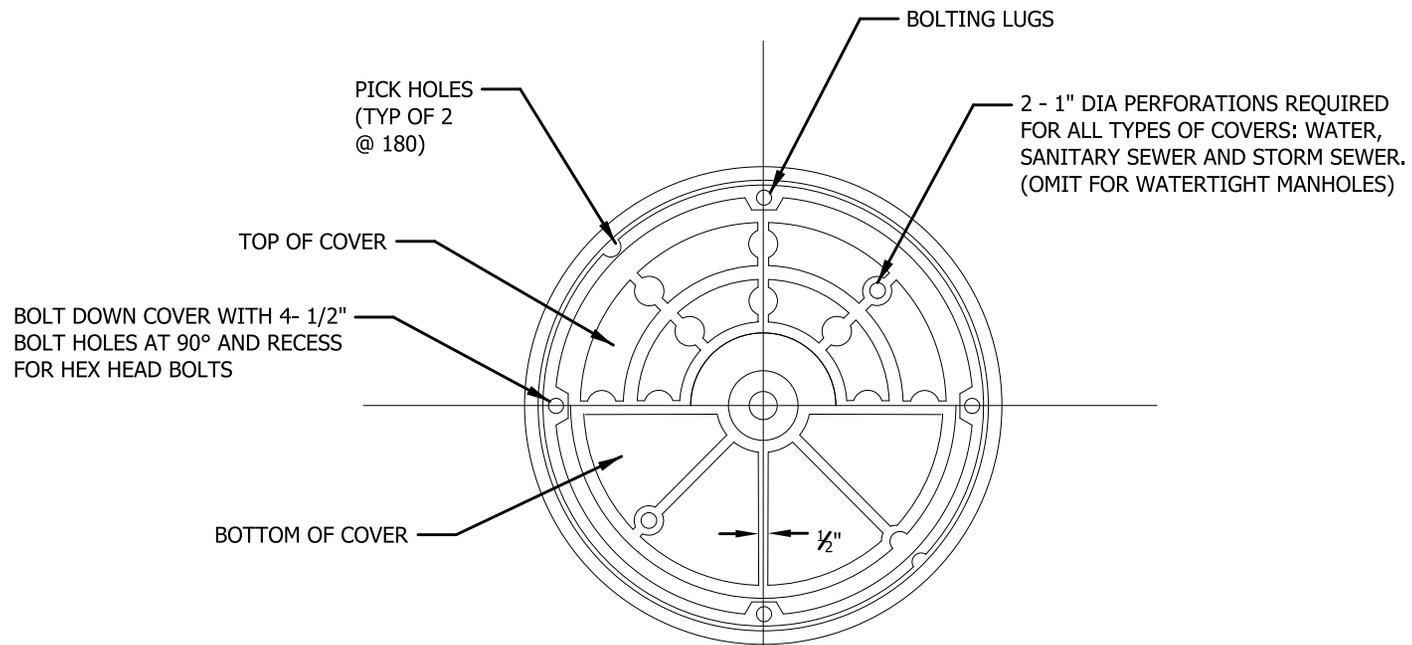

COVER LETTERING DETAIL

- NOTES:
- 1) ALL BOLTS ARE TO BE TYPE 316 STAINLESS STEEL.
  - 2) USE COVER LETTERING AS APPROPRIATE FOR APPLICATION.
  - 3) RING AND COVER WILL HAVE MACHINED SEAT AND WILL CONFORM TO ASTM A48, CLASS 35B

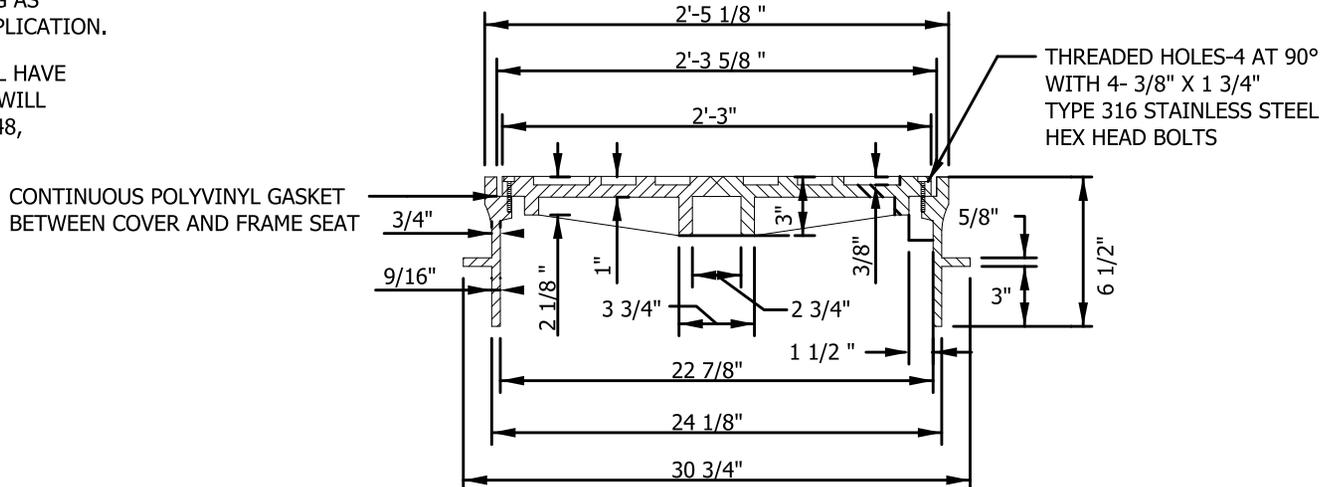


## FLAT TOP SEALED RING & COVER

DATE:	REVISIONS

# STANDARD DETAIL

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.10



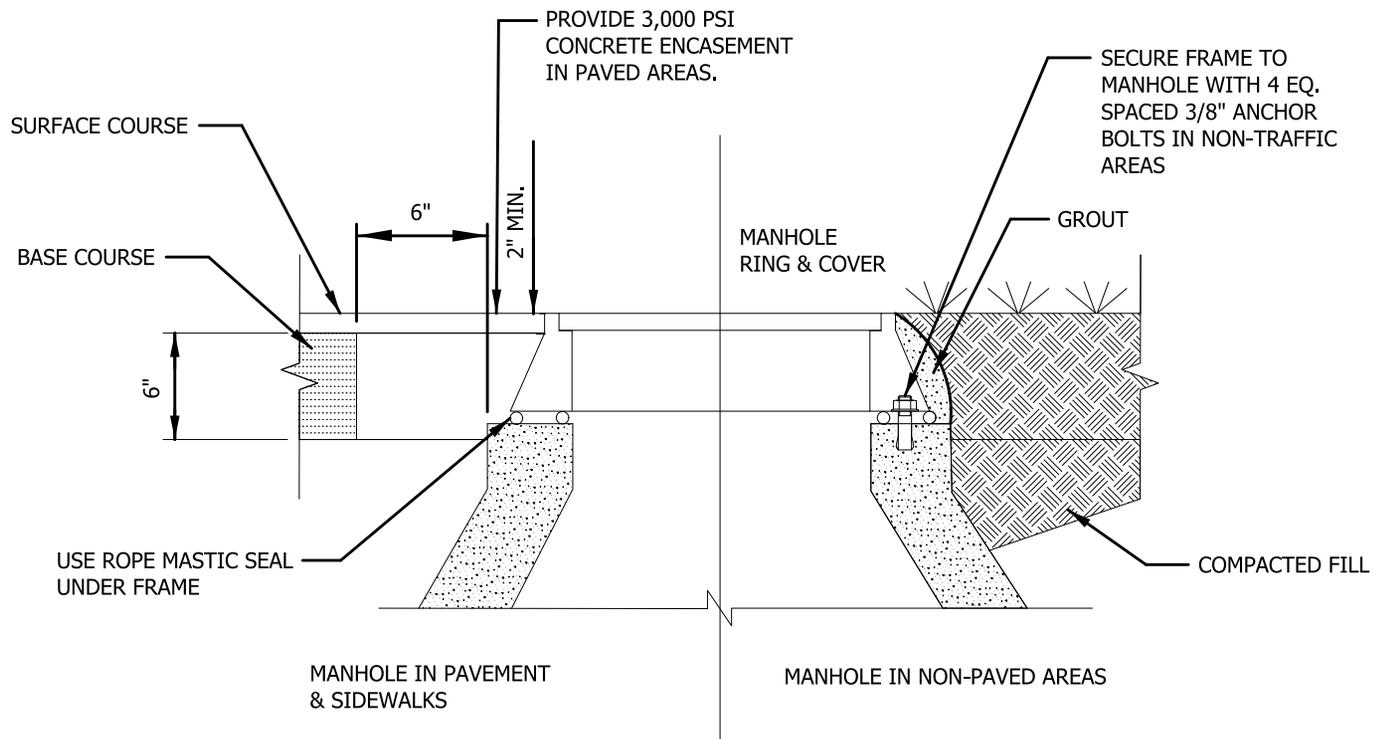

## MANHOLE RING AND COVER ANCHORING

DATE: REVISIONS

### STANDARD DETAIL


DATE: 03/07/2017

SHEET 1 OF 1


STD. No. S-1.11




Clinton  
NORTH CAROLINA

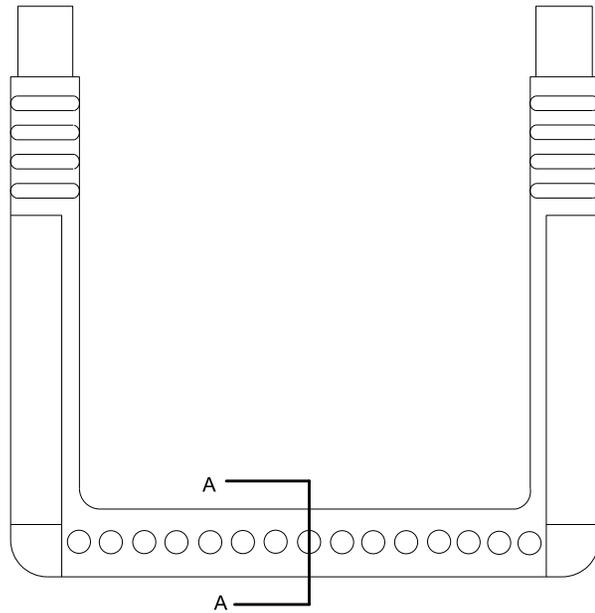


PLAN

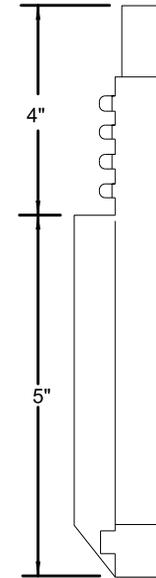

SIDE ELEVATION

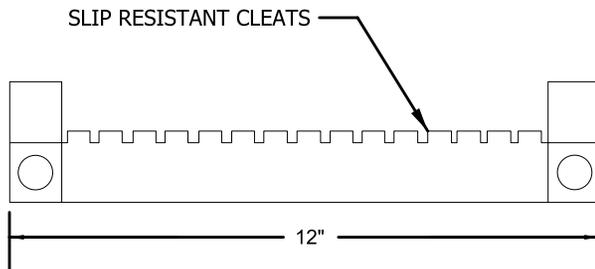

ELEVATION

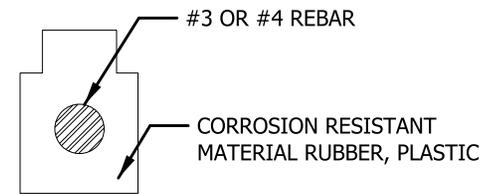

SECTION A - A

NOTE:

EMBEDMENT DEPTH OF STEP INTO CONCRETE AS PER MANUFACTURERE'S WRITTEN RECOMMENDATION.

## MANHOLE STEPS

# STANDARD DETAIL


DATE:	REVISIONS

DATE: 03/07/2017

SHEET 1 OF 1

STD. No. S-1.12



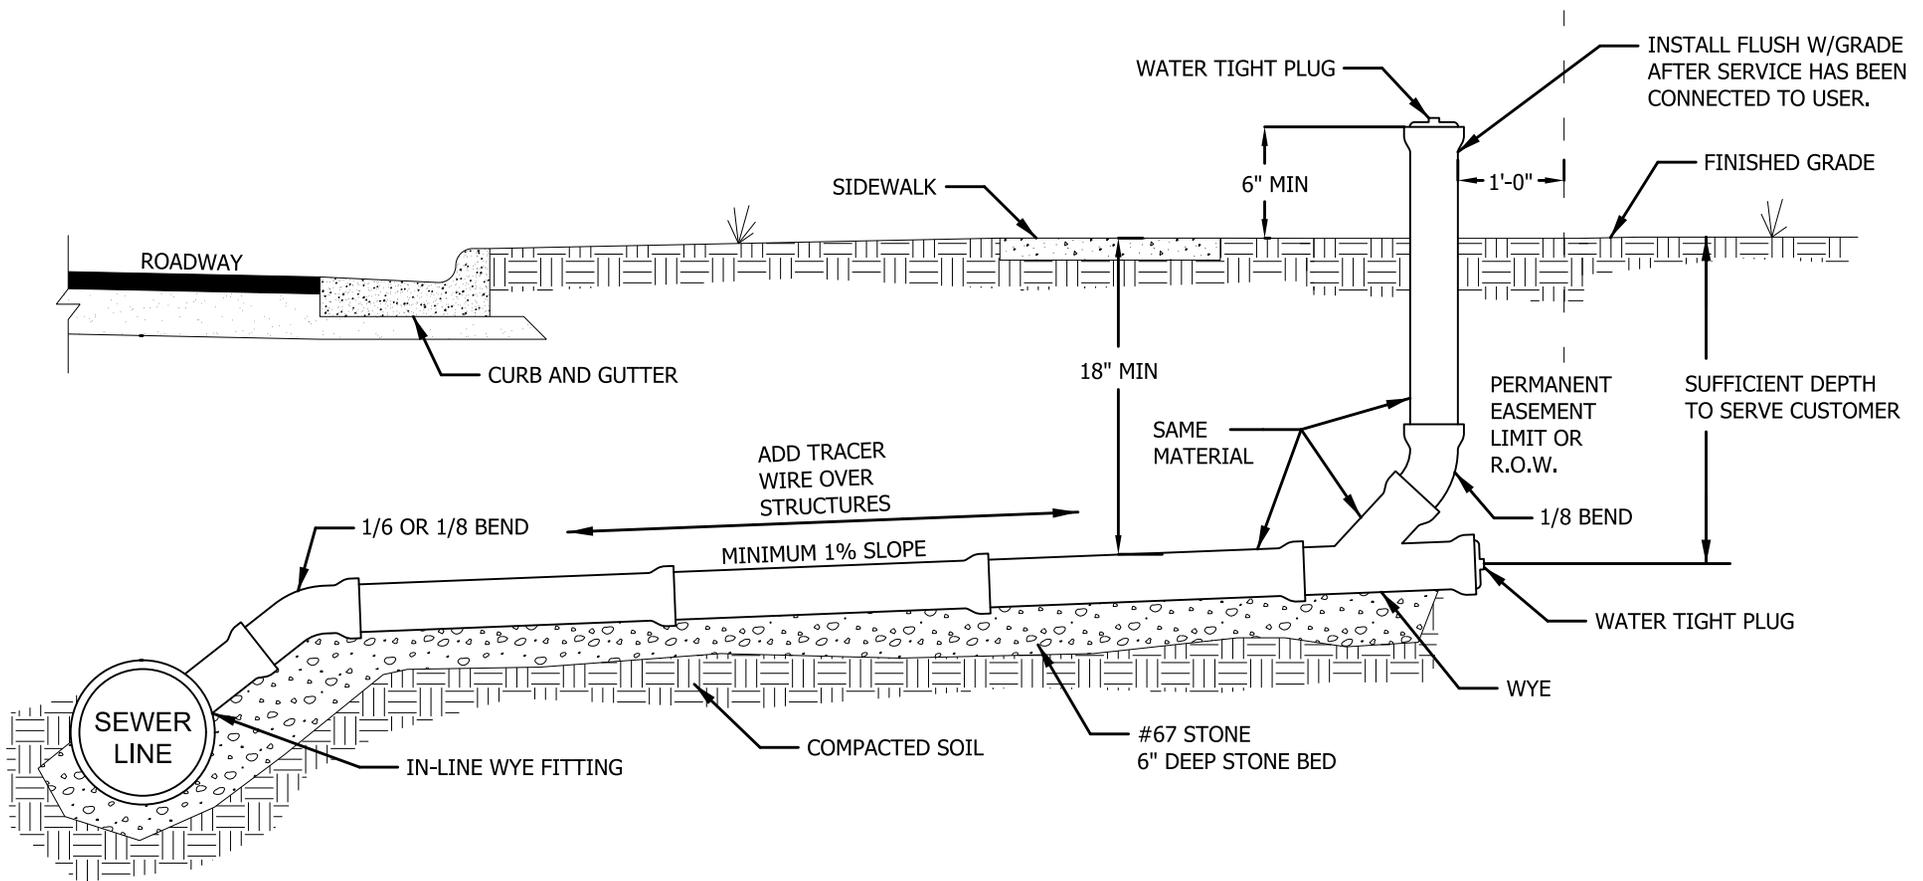

**NOTES:**

- 1) USE D.I.P. FOR LATERAL IF DEPTH IS LESS THAN 3 FT. OR GREATER THAN 12 FT.
- 2) NO TAPPING SADDLES ALLOWED FOR NEW MAIN CONSTRUCTION. IF USED ON AN EXISTING LINE, SADDLE SHALL BE ROMAC INDUSTRIES STYLE CB OR APPROVED EQUAL.
- 3) NO TAPPING OF CLEAN OUT RISER. CONNECTION MUST BE MADE TO PLUGGED END.
- 4) SEWER SERVICE PIPING AND FITTINGS TO BE 4" UNLESS OTHERWISE SPECIFIED.

**DEPTH < 20 FEET:**

- UNDERCUT TRENCH BOTTOM 6 INCHES MINIMUM BELOW PIPE
- FILL PIPE TO SPRING LINE WITH NO. 67 STONE

**DEPTH > 20 FEET:**

- UNDERCUT TRENCH BOTTOM 6 INCHES MINIMUM BELOW PIPE
- FILL TO 6 INCHES ABOVE PIPE WITH NO. 67 STONE


## STANDARD SANITARY SEWER SERVICE

DATE:	REVISIONS

# STANDARD DETAIL

DATE: 03/07/2017  
SHEET 1 OF 1  
STD. No. S-1.13



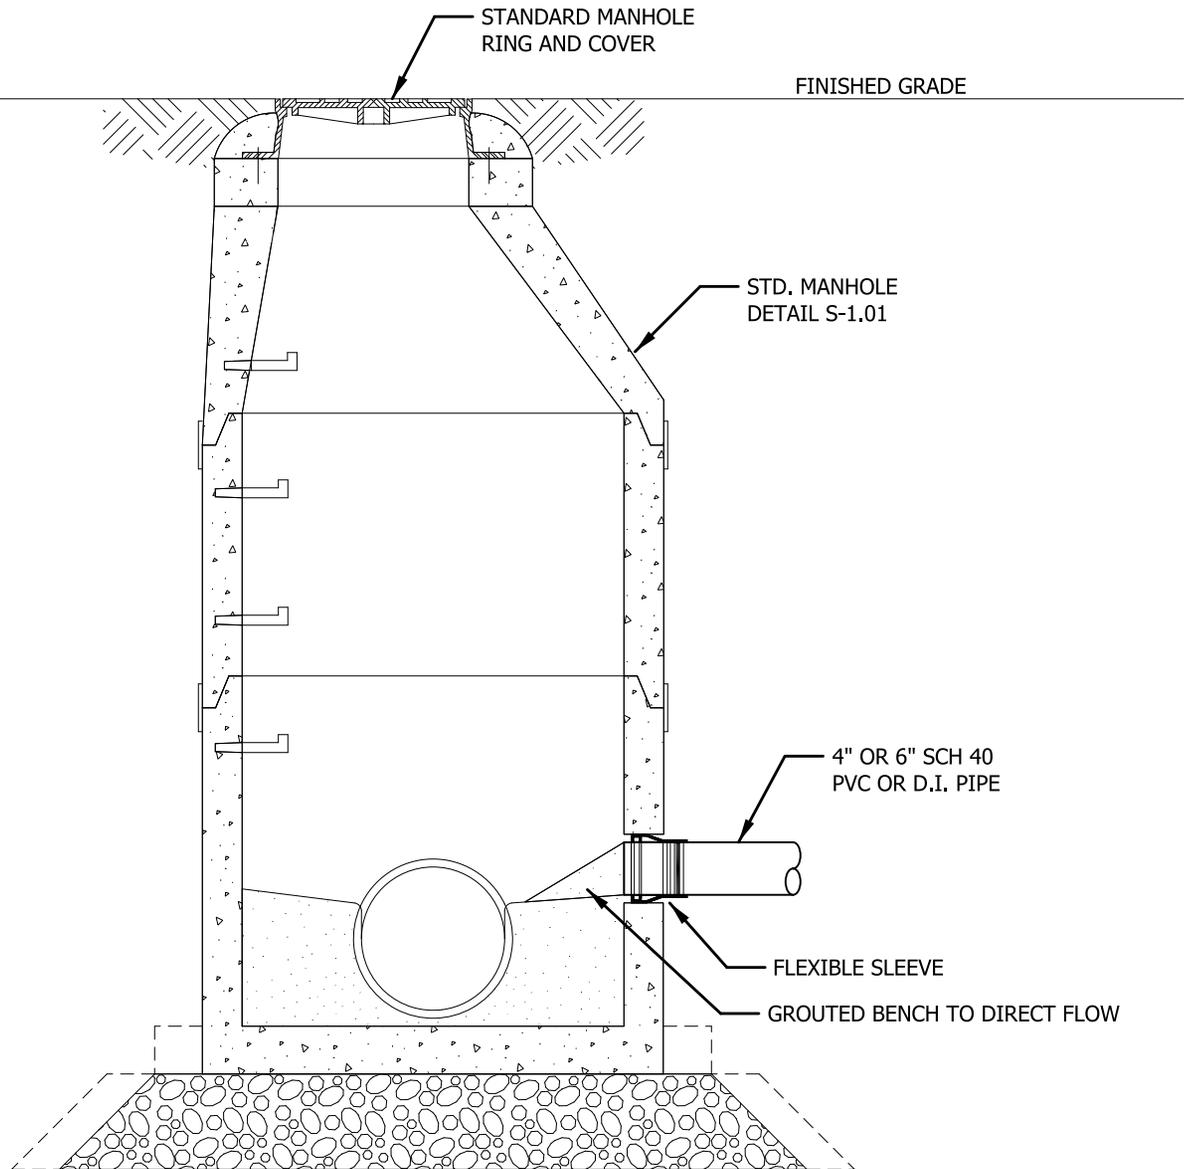

**NOTE:**

CONNECTION OF PIPE TO MANHOLE SHALL BE MADE WATERTIGHT USING RESILIENT CONNECTORS CONFORMING TO ASTM C 923 OR NEOPRENE BOOTS EMBEDDED IN PRECAST BASE WITH STAINLESS STEEL COMPRESSED BANDS.

## SEWER LATERAL CONNECTION TO MANHOLE

DATE:	REVISIONS


### STANDARD DETAIL

DATE: 03/07/2017


SHEET 1 OF 1

STD. No. S-1.14



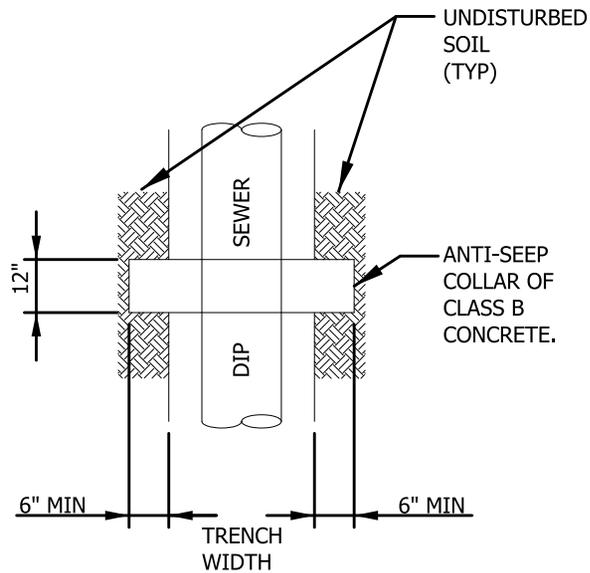

PLAN

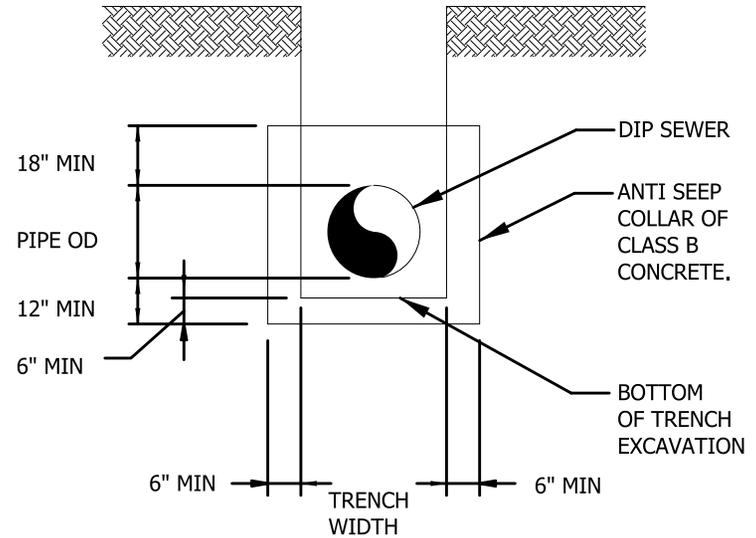

SECTION

NOTE:  
SEE PLAN SHEET FOR LOCATION AND SPACING


## ANTI-SEEP COLLAR

# STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.15



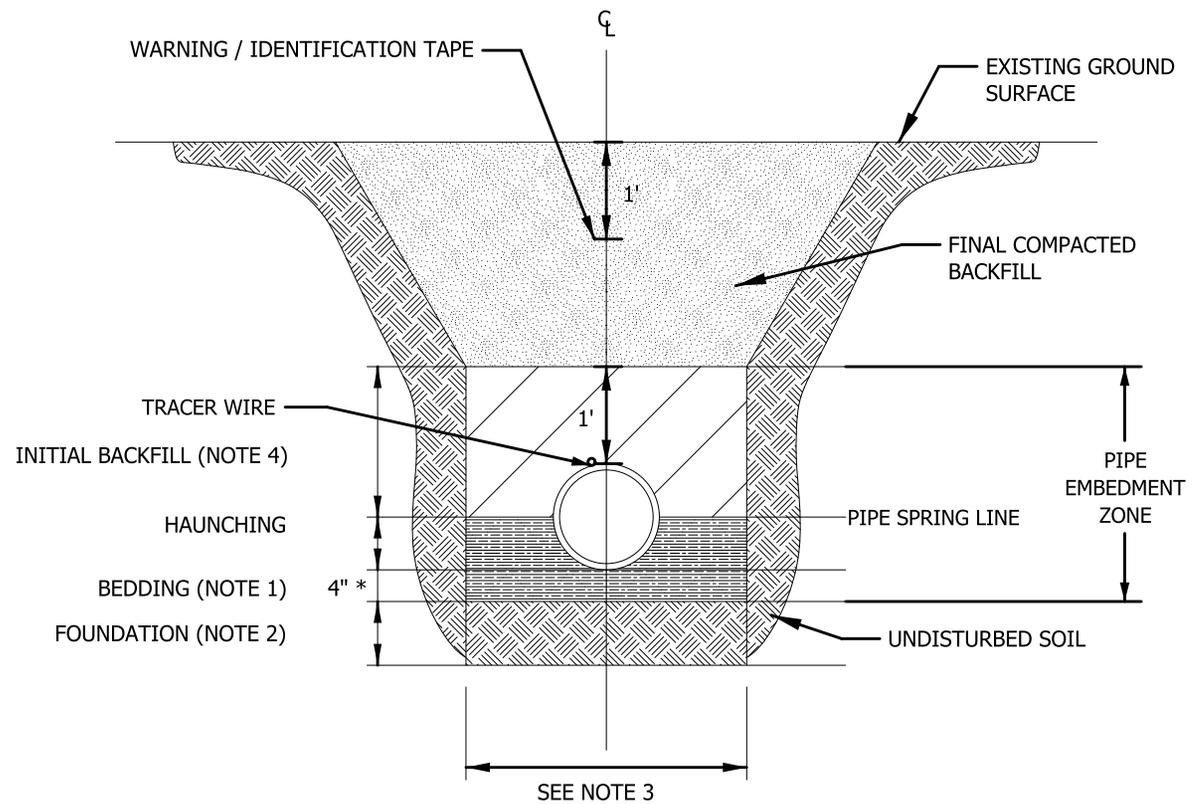

**NOTES:**

- 1) STONE BEDDING IS NOT REQUIRED IN SUITABLE CLASS I, CLASS II, CLASS III, AND STABLE CLASS IV SOILS. PROVIDE STONE BEDDING IN UNSTABLE CLASS IV OR CLASS V SOILS, RUNNING WATER OR OTHER UNSTABLE SOIL CONDITIONS IN BEDDING AND HAUNCH ZONE. BACKFILL WITH CLASS I, II, OR III MATERIAL IN INITIAL BACKFILL.
- 2) CLASS I FOUNDATION STONE SHALL BE REQUIRED WHEN SOIL CONDITIONS ARE UNSTABLE. UNDERCUT DEPTH AS DIRECTED BY CITY.
- 3) TRENCH WIDTH IS MINIMUM OF THE PIPE O.D. PLUS 18" AND MAXIMUM OF PIPE O.D. PLUS 24".
- 4) INITIAL BACKFILL SHALL BE PLACED AND COMPACTED IN 6" LIFTS. INITIAL BACKFILL SHALL CONTAIN NO MATERIAL OVER 1 1/2" IN DIAMETER, FROZEN LUMPS, OR DEBRIS.
- 5) BACKFILL SHALL BE COMPACTED IN ACCORDANCE WITH SPECIFICATIONS.

\* 6" REQUIRED FOR PIPES GREATER THAN 30" IN DIAMETER


## DUCTILE IRON (RIGID) PIPE GRAVITY SEWER BEDDING

DATE:	REVISIONS

# STANDARD DETAIL

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.16



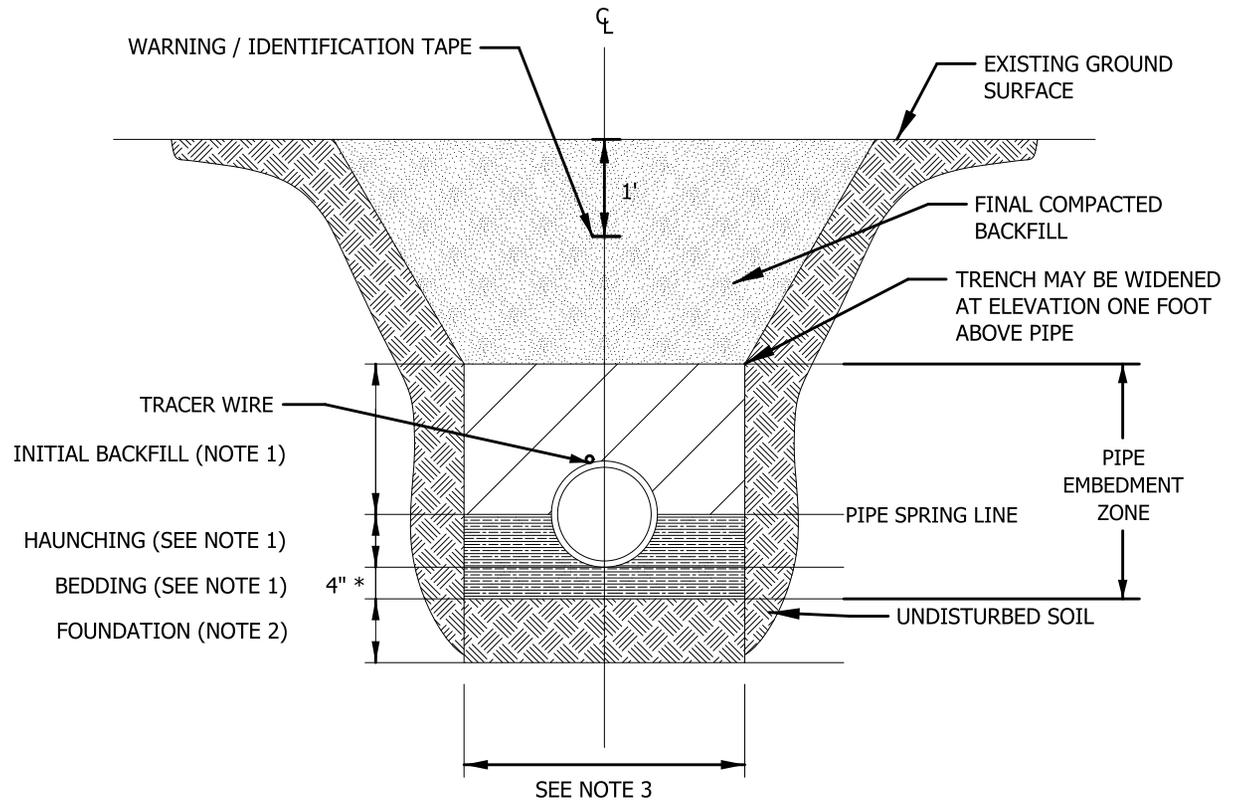

\* 6" REQUIRED FOR PIPES GREATER THAN 30" IN DIAMETER

**NOTES:**

- 1) FOR DEPTHS UP TO 14 FEET PROVIDE CLASS I MATERIAL FOR BEDDING AND HAUNCHING. BACKFILL WITH CLASS I, II, OR III MATERIAL IN INITIAL BACKFILL. FOR DEPTHS GREATER THAN 14 FEET, PROVIDE CLASS I MATERIAL FOR BEDDING HAUNCHING AND INITIAL BACKFILL.
- 2) CLASS I FOUNDATION STONE SHALL BE REQUIRED WHEN SOIL CONDITIONS ARE UNSTABLE. UNDERCUT DEPTH AS DIRECTED BY CITY.
- 3) TRENCH WIDTH IS MINIMUM OF THE PIPE O.D. PLUS 18" AND MAXIMUM OF PIPE O.D. PLUS 24".
- 4) INITIAL BACKFILL SHALL BE PLACED AND COMPACTED IN 6" LIFTS. INITIAL BACKFILL SHALL CONTAIN NO MATERIAL OVER 1 1/2" IN DIAMETER, FROZEN LUMPS, OR DEBRIS.
- 5) BACKFILL SHALL BE COMPACTED IN ACCORDANCE WITH SPECIFICATIONS.

## PVC (FLEXIBLE) PIPE GRAVITY SEWER BEDDING




Clinton

NORTH CAROLINA

DATE:	REVISIONS

# STANDARD DETAIL

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.17

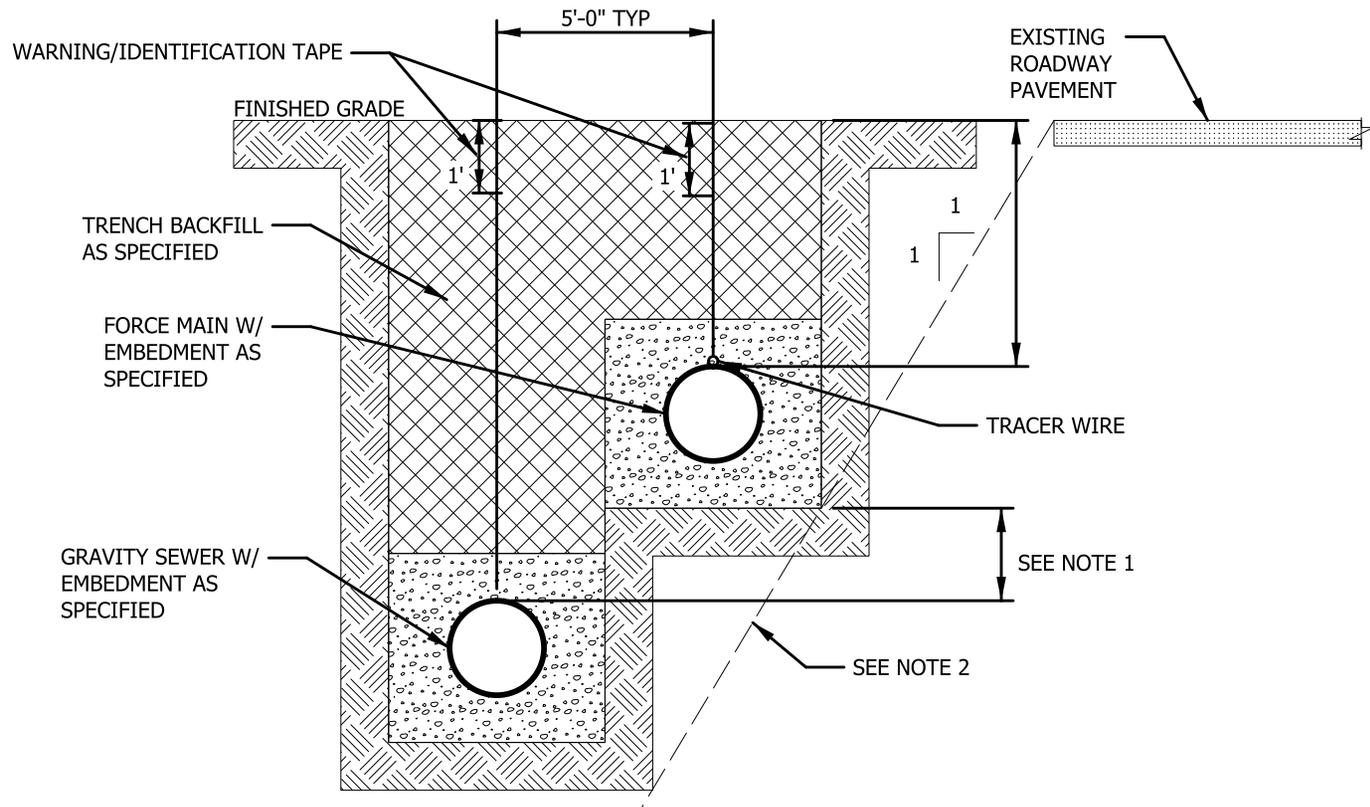

NOTES:

- 1) PROVIDE SUFFICIENT VERTICAL CLEARANCE BETWEEN GRAVITY SEWER AND FORCE MAIN SO AS TO ALLOW FUTURE MAIN AND SERVICE CONNECTIONS TO GRAVITY SEWER.
- 2) ALL TRENCHING ADJACENT TO ROADWAY SHALL BE OUTSIDE THE THEORETICAL 1:1 SLOPE FROM THE EXISTING EDGE OF PAVEMENT.


## TYPICAL TRENCH GRAVITY SEWER AND FORCE MAIN

DATE:	REVISIONS

## STANDARD DETAIL

DATE: 03/07/2017  
SHEET 1 OF 1  
STD. No. S-1.18



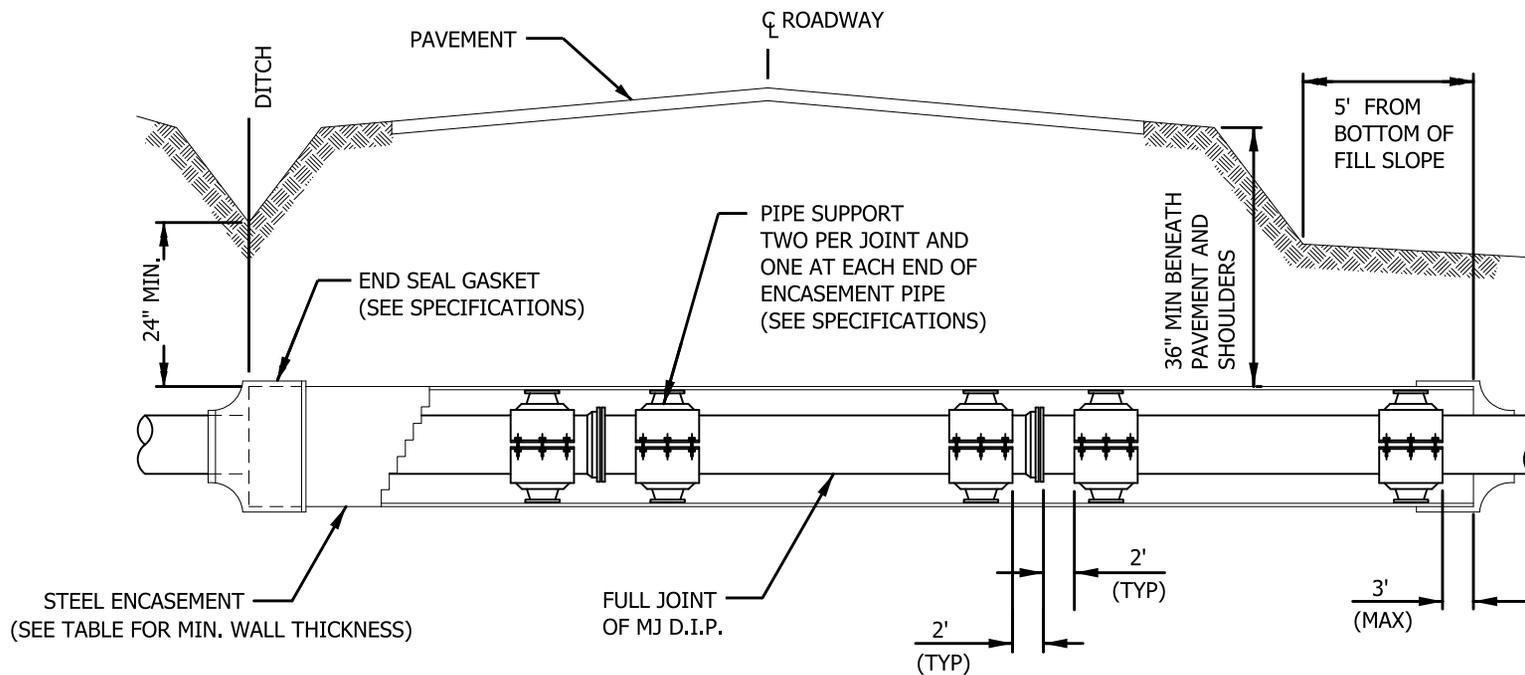

NOTES:

- 1) FOR ROADS WITH ADT <2000, ENCASEMENT TO EXTEND 3' BEHIND CURB SECTIONS.
- 2) ENCASEMENT TO EXTEND FROM DITCH LINE TO DITCH LINE IN CUT SECTIONS.

ENCASEMENT PIPE WALL THICKNESS			
ROADWAY		RAILROAD	
PIPE SIZE (O.D. INCHES)	WALL THICKNESS	PIPE SIZE (O.D. INCHES)	WALL THICKNESS
4 - 12 3/4	0.188	12 3/4 & UNDER	0.188
16 - 24	0.250	16	0.281
30	0.312	24	0.375
36	0.375	30	0.469
42	0.500	36	0.531
48	0.500	42	0.625
		48	0.688


# PIPE INSTALLATION IN STEEL ENCASEMENT

## STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.19



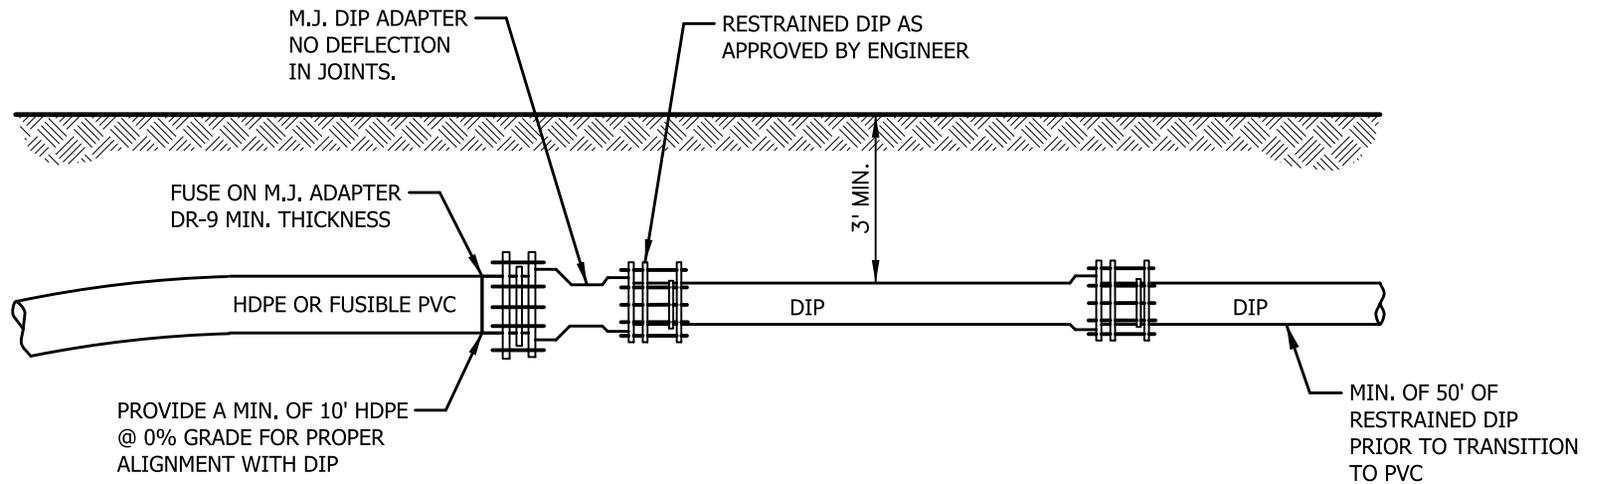

## HDPE/FUSIBLE PVC TRANSITION

DATE:	REVISIONS

STANDARD DETAIL

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.20



1 PIPE DIAMETER (INCH)	2 MINIMUM TIME (MIN:SEC)	3 LENGTH FOR MINIMUM TIME (FEET)	4 TIME FOR LONGER LENGTH (SEC)	5 SPECIFICATION TIME FOR LENGTH (L) SHOWN (MIN:SEC)								
				100FT	150FT	200FT	250FT	300FT	350FT	400FT	450FT	
4	3:46	597	.380 L	3:46	3:46	3:46	3:46	3:46	3:46	3:46	3:46	3:46
6	5:40	398	.854 L	5:40	5:40	5:40	5:40	5:40	5:40	5:40	5:42	6:24
8	7:34	298	1.520 L	7:34	7:34	7:34	7:36	7:36	8:52	10:08	11:24	
10	9:26	239	2.374 L	9:26	9:26	9:26	9:53	11:52	13:51	15:49	17:48	
12	11:20	199	3.418 L	11:20	11:20	11:24	14:15	17:05	19:56	22:47	25:38	
15	14:10	159	5.324 L	14:10	14:10	17:48	22:15	26:42	31:09	31:36	40:04	
18	17:00	133	7.692 L	17:00	19:13	25:38	32:03	38:27	44:52	51:16	57:41	
21	19:50	114	10.470 L	19:50	26:10	34:54	43:37	52:21	61:00	69:48	78:31	
24	22:40	99	13.674 L	22:47	34:11	45:34	56:58	68:22	79:46	91:10	102:33	
27	25:30	88	17.306 L	28:51	43:16	57:41	72:07	86:32	100:57	115:22	129:48	
30	28:20	80	21.366 L	35:37	53:25	71:13	89:02	106:50	124:38	142:26	160:15	
33	31:10	72	25.852 L	43:05	64:38	86:10	107:43	129:16	150:43	172:21	193:53	
36	34:00	66	30.768 L	51:17	76:55	102:34	128:12	153:50	179:29	205:07	230:46	

## LOW PRESSURE AIR TESTING FOR GRAVITY SEWER MAINS




Clinton

NORTH CAROLINA

DATE:	REVISIONS

# STANDARD DETAIL

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.21

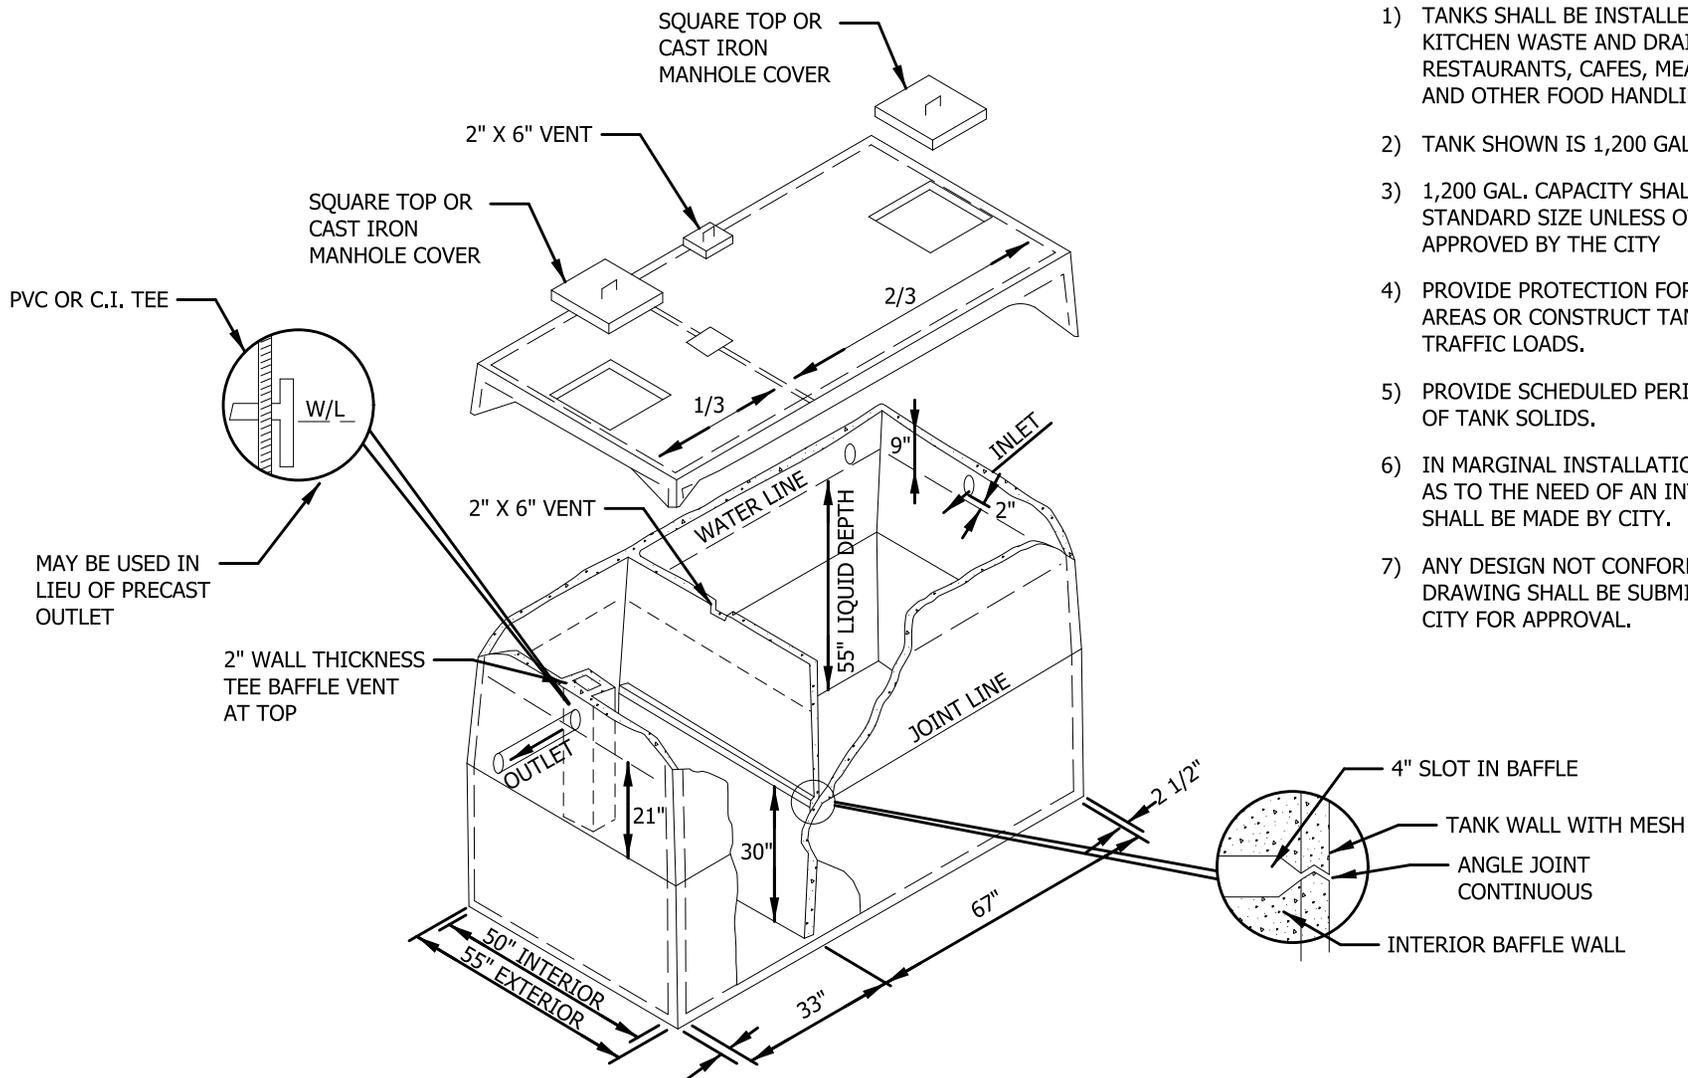

- NOTES:
- 1) TANKS SHALL BE INSTALLED ON ALL KITCHEN WASTE AND DRAIN LINES FROM RESTAURANTS, CAFES, MEAT MARKETS, AND OTHER FOOD HANDLING ESTABLISHMENTS.
  - 2) TANK SHOWN IS 1,200 GAL. CAPACITY.
  - 3) 1,200 GAL. CAPACITY SHALL BE THE STANDARD SIZE UNLESS OTHERWISE APPROVED BY THE CITY
  - 4) PROVIDE PROTECTION FOR TANK IN TRAFFIC AREAS OR CONSTRUCT TANK TO WITHSTAND TRAFFIC LOADS.
  - 5) PROVIDE SCHEDULED PERIODIC CLEANING OF TANK SOLIDS.
  - 6) IN MARGINAL INSTALLATIONS, THE DECISION AS TO THE NEED OF AN INTERCEPTOR SHALL BE MADE BY CITY.
  - 7) ANY DESIGN NOT CONFORMING TO THIS DRAWING SHALL BE SUBMITTED TO CITY FOR APPROVAL.

## TYPICAL TWO COMPARTMENT GREASE INTERCEPTOR TANK


### STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 1 OF 1
STD. No. S-1.22





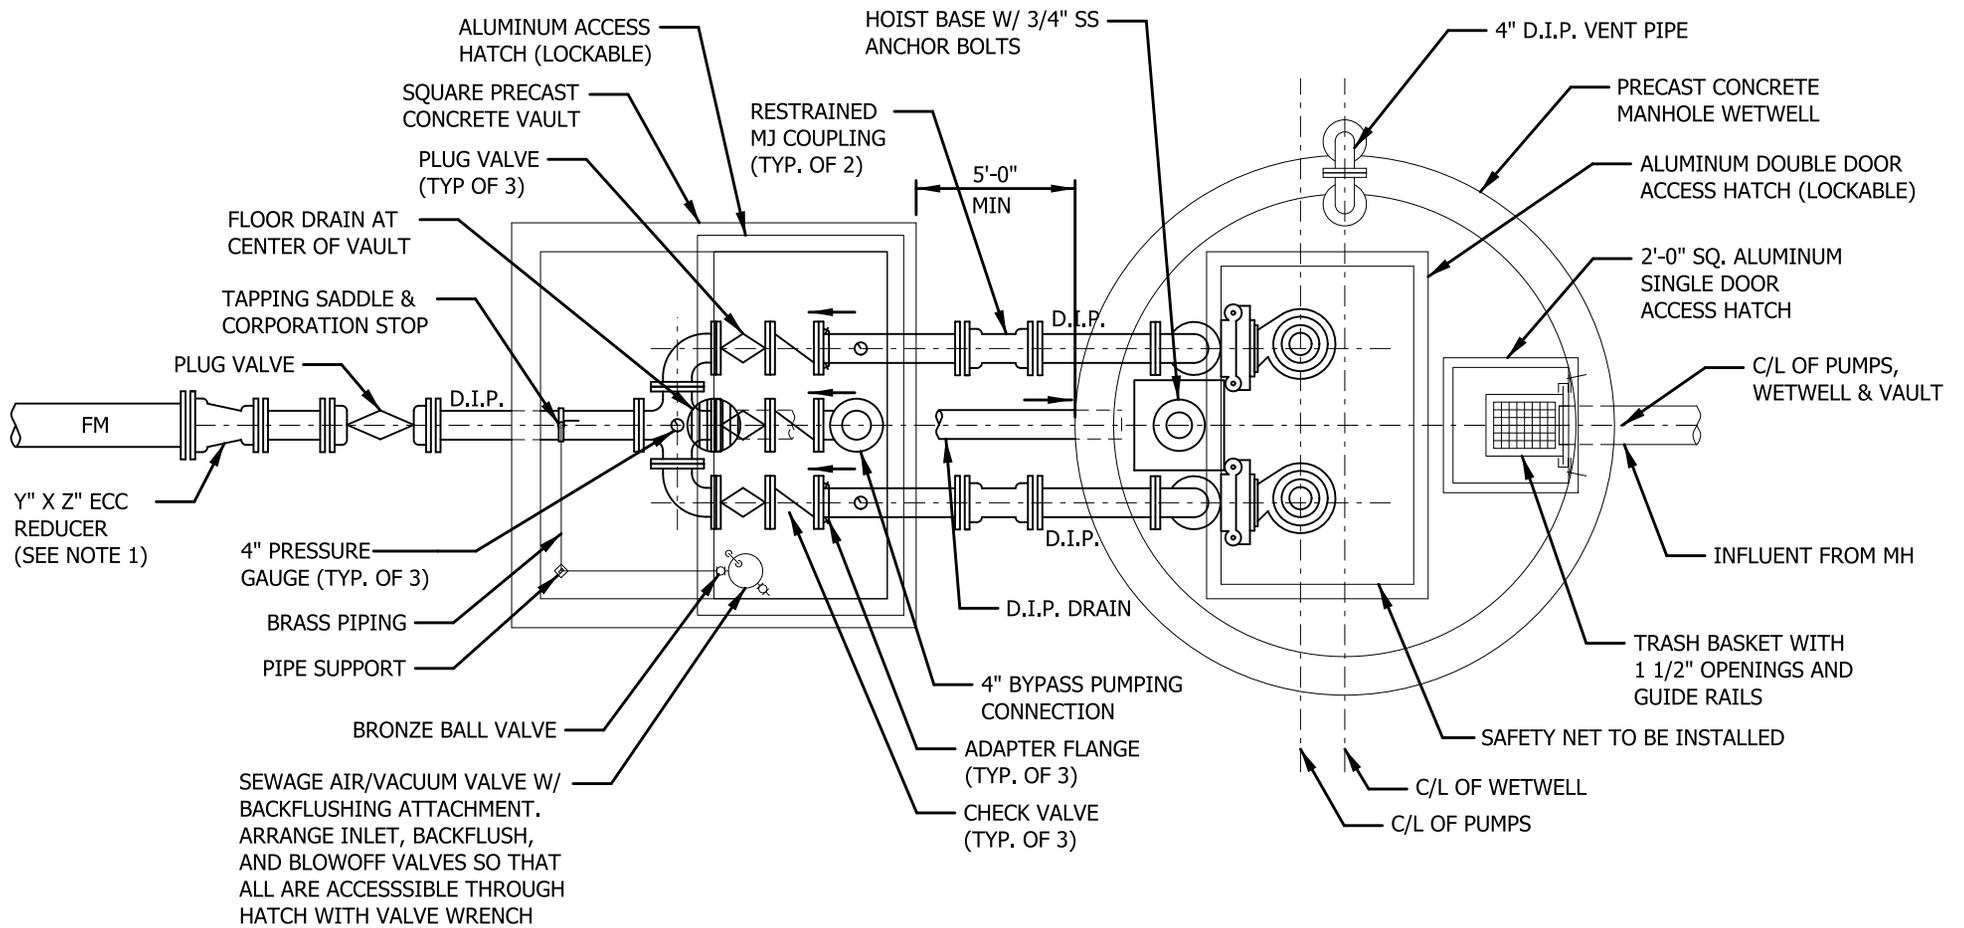

PLAN

NOTES:

- 1) VALVE VAULT EFFLUENT PIPING IS SHOWN FOR A FORCE MAIN ON A DOWNWARD SLOPE AWAY FROM PUMP STATION. FOR A FORCE MAIN ON AN UPWARD SLOPE AWAY FROM PUMP STATION, THE DESIGNER MAY CONSIDER ROTATING THE ECCENTRIC REDUCER (IF USED) AND DELETING THE ARV.
- 2) USE D.I.P. THROUGHOUT THE PUMP STATION.
- 3) ACCESS HATCHES TO BE SIZED TO FACILITATE THE EASY REMOVAL OF PUMPS, VALVES, ETC.
- 4) LAYOUT SHOWN IS TYPICAL FOR THE CITY OF CLAREMONT. FINAL DESIGN AND LAYOUT OF ALL PUMP STATIONS MUST BE APPROVED BY THE CITY.


## TYPICAL PUMP STATION

### STANDARD DETAIL

DATE:	REVISIONS

DATE: 03/07/2017
SHEET 2 OF 5
STD. No. S-1.23



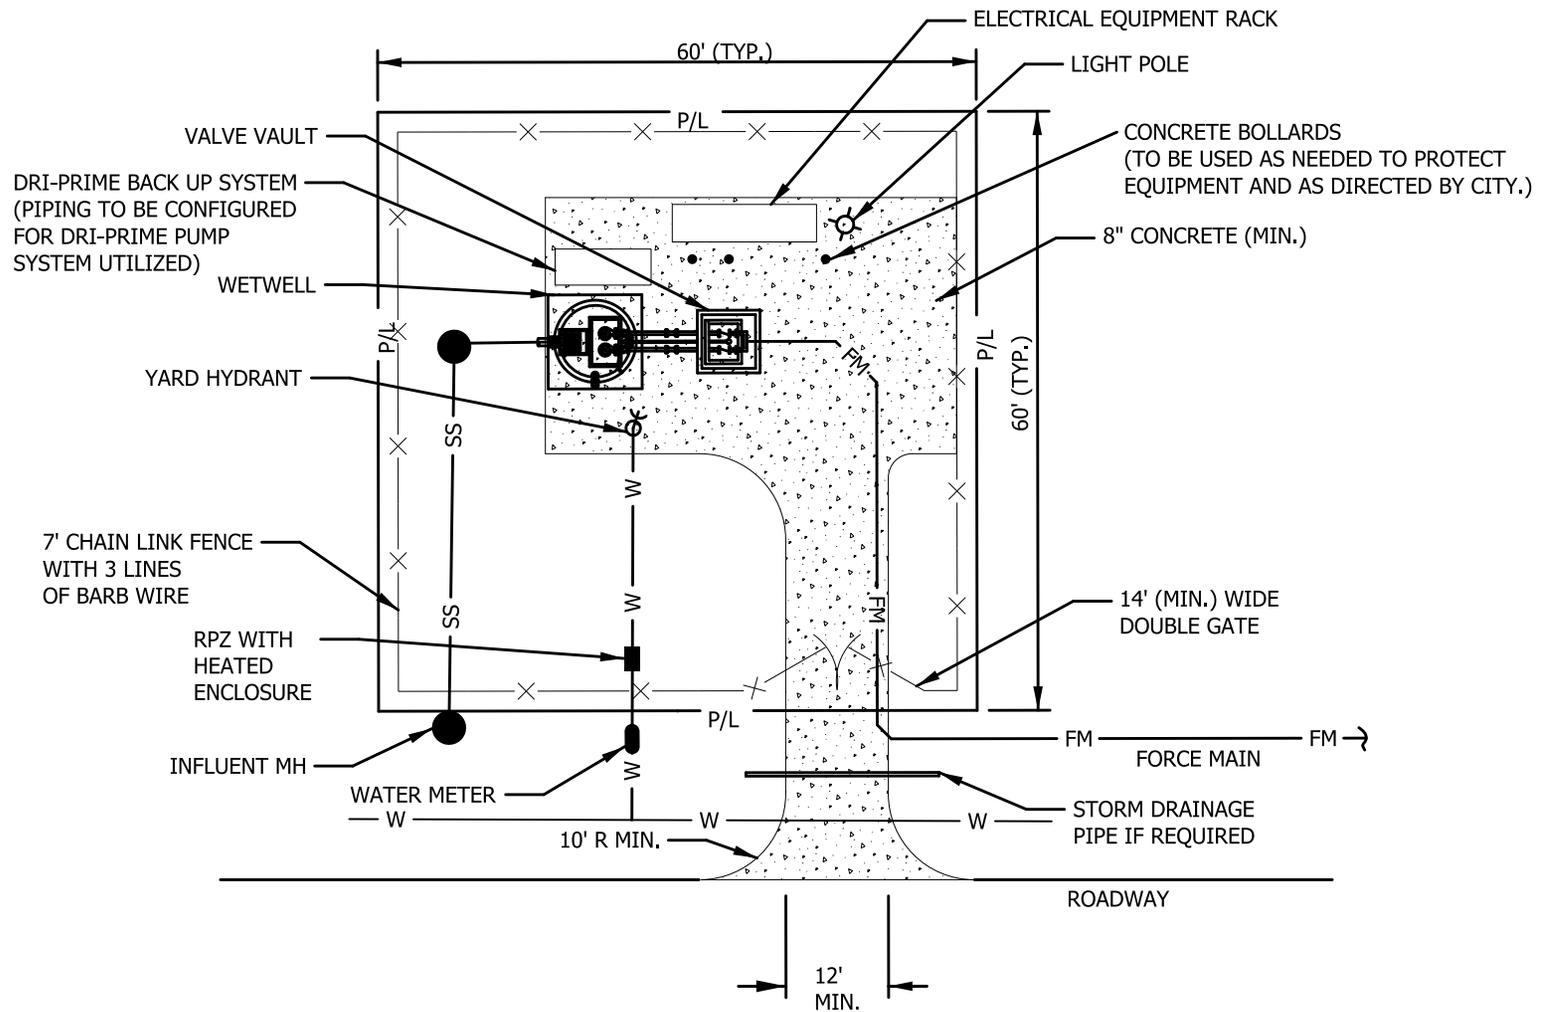

NOTES:

- 1) ORIENTATION OF COMPONENTS MAY BE ADJUSTED TO SUIT SITE CONDITIONS.
- 2) MAINTAIN REQUIRED SEPARATION BETWEEN SEWER AND WATER LINES.

SITE


## TYPICAL PUMP STATION LAYOUT

DATE:	REVISIONS

## STANDARD DETAIL

DATE: 03/07/2017
SHEET 3 OF 5
STD. No. S-1.23



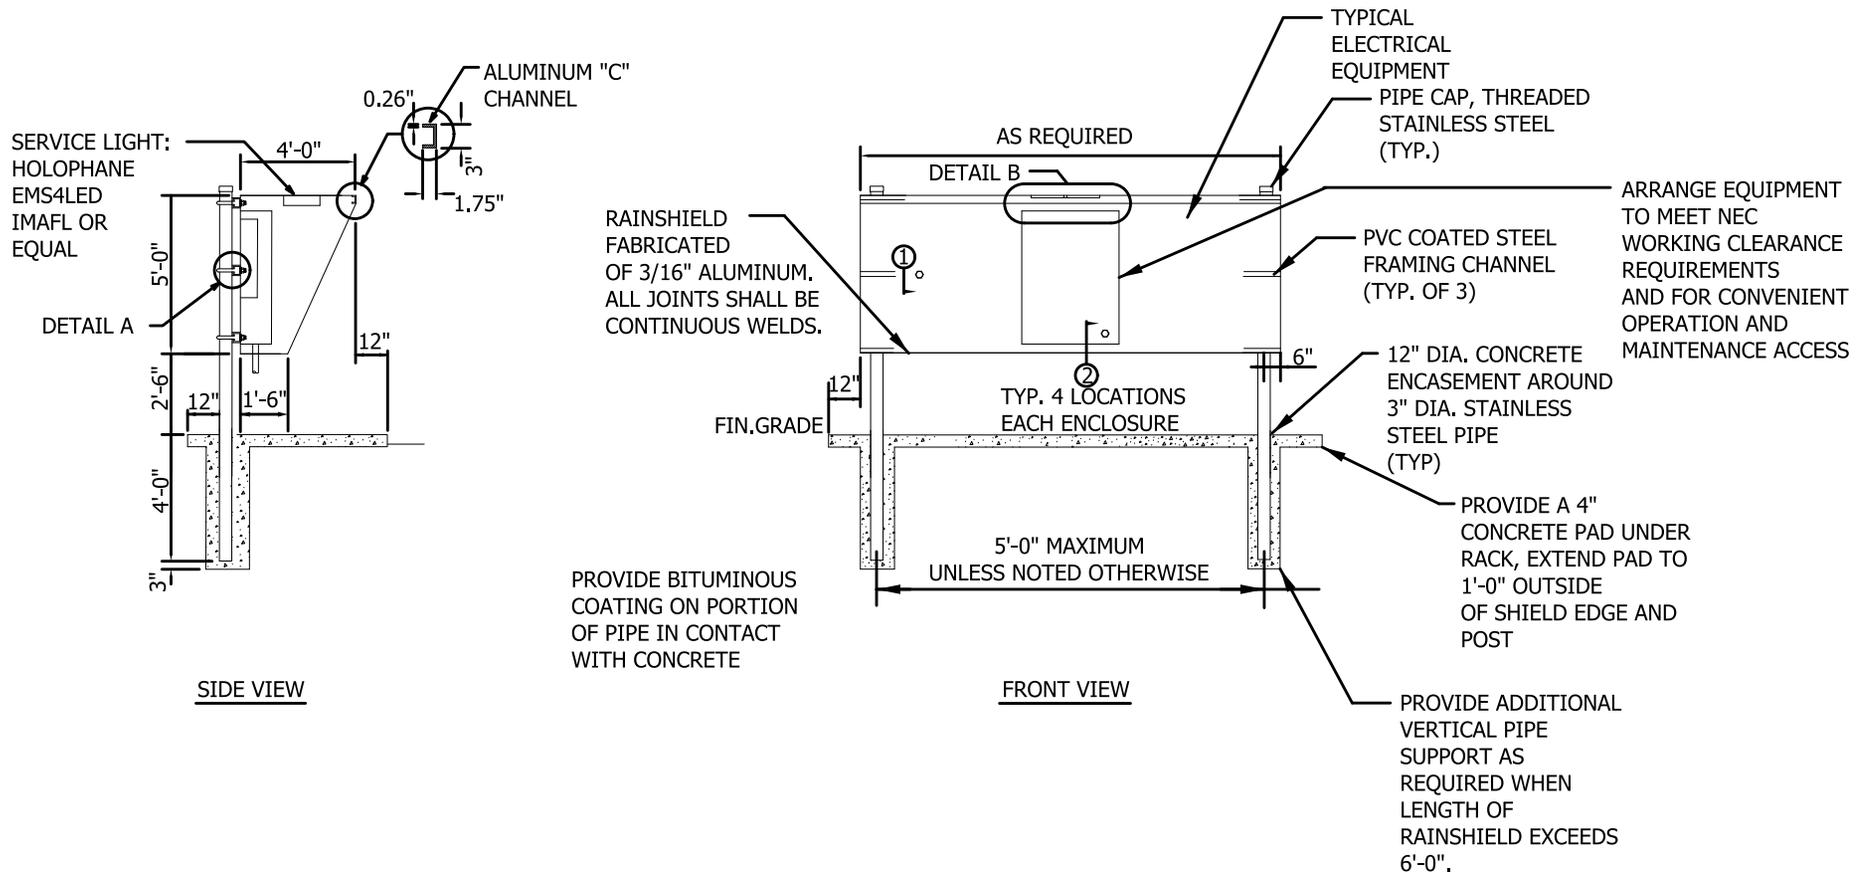

## TYPICAL PUMP STATION EQUIPMENT MOUNTING RACK

### STANDARD DETAIL


DATE:	REVISIONS

DATE: 03/07/2017

SHEET 4 OF 5

STD. No. S-1.23



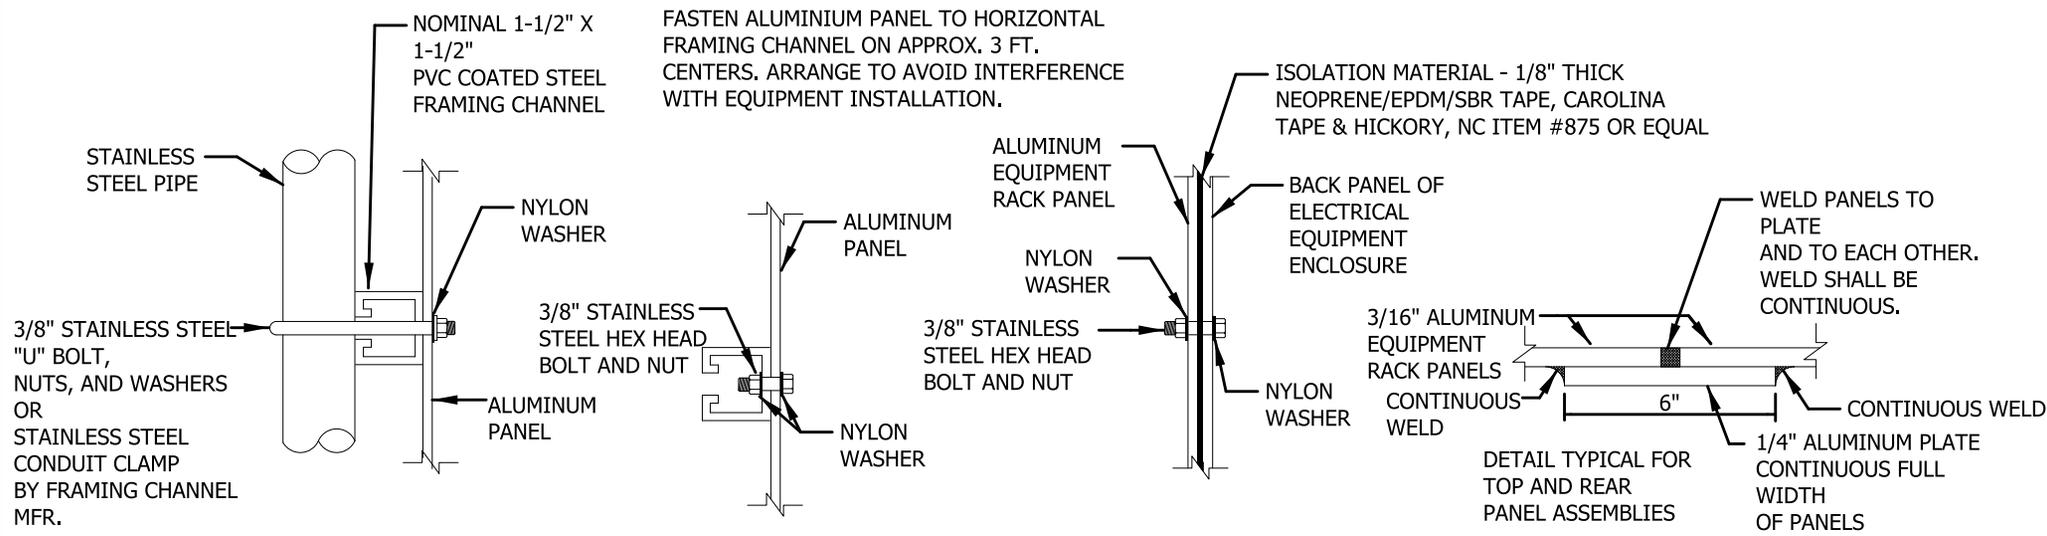

DETAIL A  
(TYP. 3 LOCATIONS EACH POLE)

SECTION ①

SECTION ②

DETAIL B

PROVIDE SPLICE IF LENGTH OF EQUIPMENT RACK EXCEEDS STANDARD PANEL LENGTH.

# TYPICAL PUMP STATION EQUIPMENT MOUNTING RACK

DATE:	REVISIONS

## STANDARD DETAIL

DATE: 03/07/2017
SHEET 5 OF 5
STD. No. S-1.23

